



Logicwall® Certification, Load resistance, FRL Certification, CSIRO Assessment, Acoustic Performance, Thermal Performance, Compaction Test, Bracing Design.



Contents

L1. Certification3

Structure.3

Fig L1: Van Der Meer Consulting Letter.....	3
Fig L2: Lateral Load Resistance of AFS Wall Panels.	5
Fig L3: Durability Compliance.....	6
Fig L4: AFS Unisearch Report.....	8
Fig L5: FRL Certificate for LW150 Logicwall®.....	9
Fig L6: FRL Certificate for LW120 Logicwall®	10
Fig L7: FRL Assessment	11
Fig L8: CSIRO Assessment Report	12
Fig L9: Acoustic Performance Assessment	13
Fig L10: Acoustic Performance Assessment	14
Fig L11: Acoustic Performance Assessment	15
Fig L12: CSIRO Laboratory Measurement of Airborne Sound Insulation.....	16
Fig L13: Thermal Performance	17
Fig L14: Corefill Compaction Test.....	18
Fig L15: Weatherproofing	28
Fig L16: Lifting Bar Certification.....	29
Fig L17: Bracing Design Certification.....	32

L1. Certification

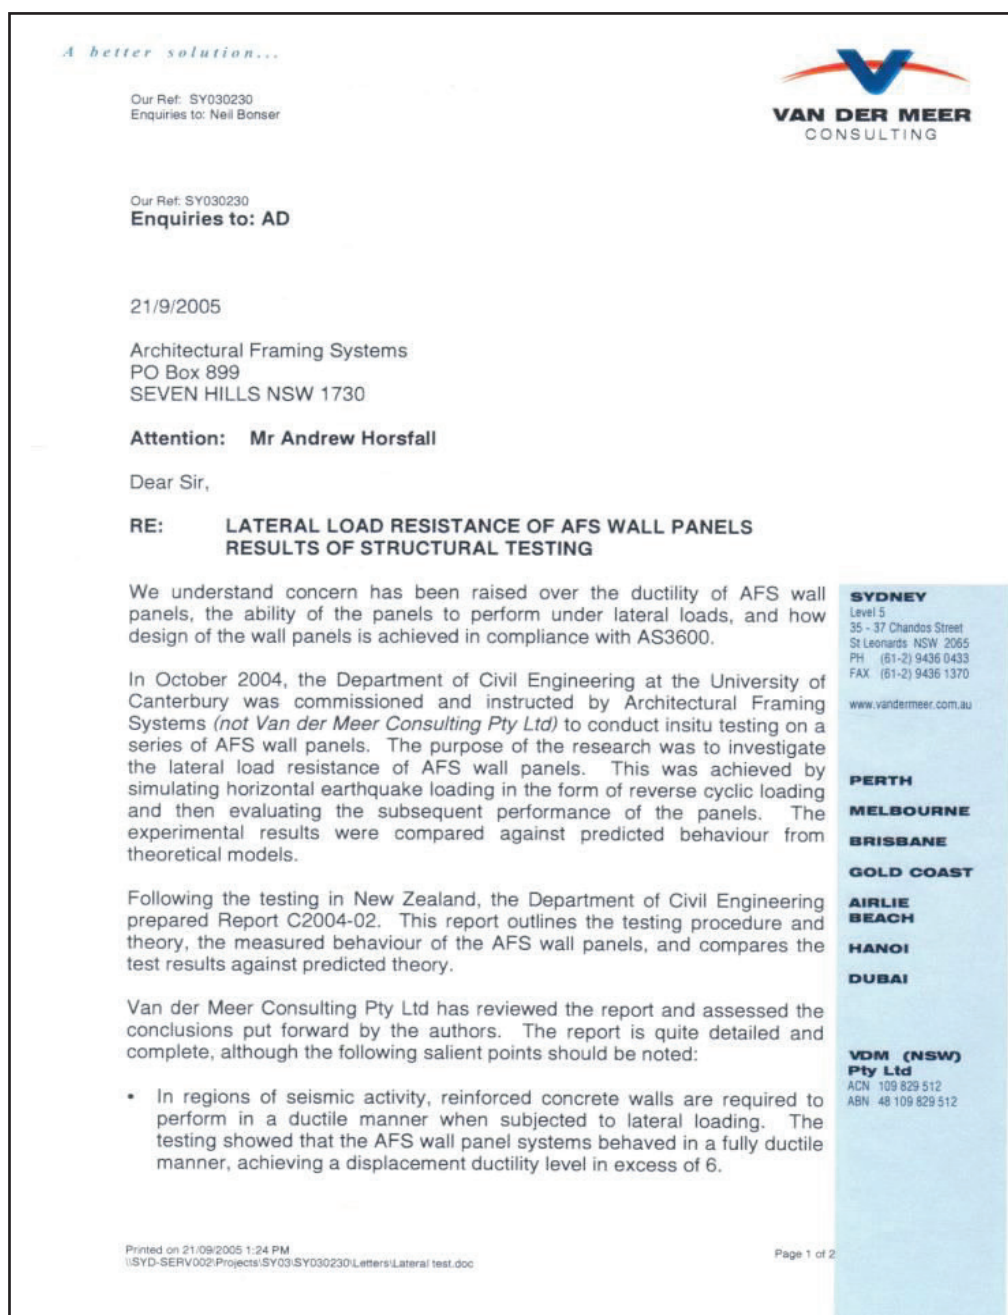
Disclaimer: This section of the AFS Logicwall® Design Guide is intended only by AFS to represent good building practice in achieving suitable internal design of AFS Logicwall®. This section is not intended in any way by AFS to represent all relevant information required on a project. It is the responsibility of those using AFS Logicwall®, including but not limited to builders, designers, consultants and engineers, to ensure that AFS Logicwall® is suitable for use on a project in relation to internal design. All diagram, plans and illustrations used in this section including any reinforcement shown are included for indicative and diagrammatic purposes only. It remains the responsibility of those using AFS Logicwall® to ensure that reference is made to the structural engineer's details for all diagrammatic and reinforcement requirements.

Structure

In October 2004 Logicwall® was subjected to a lateral load resistance test by the University of Canterbury in New Zealand.

The following letter (Fig L1) from Van Der Meer Consulting Engineers is a summary of the test and its results.

Fig L1: Van Der Meer Consulting Letter



A better solution...



- The flexural response of the AFS wall panels was adequately predicted using conventional reinforced concrete theory and analysis techniques. In fact, testing showed that the actual lateral load resisting capacity of the wall panels exceeded the theoretical value by as much as 38%.
- The vertical steel stud members in the AFS wall panels act as flexural reinforcement in the wall panels, effectively limiting the length of the plastic hinge zone to the junction between the wall and foundation members. This did not adversely affect the performance of the walls in the experimental testing.
- We are aware concern has been raised in the past regarding the slip shear interface between the concrete and the vertical steel studs in the wall panels. The testing has shown that the shear reinforcement requirements for the AFS wall panel systems are adequately predicted using the AFS design method (as outlined in the AFS Technical Manual). The authors recommend that the conservative estimates of β_4 & β_5 developed by AFS be adopted.
- No shear deformations were found to occur within the AFS wall panels during the testing. This finding was the case for all test specimens and was independent on the amount of shear reinforcement.
- Testing confirms AFS' recommendations that the height-to-length ratio of the wall panels should not exceed 1.0 when being relied upon as shear walls.

Based on the testing and the conclusions of the authors, we advise that the behaviour and design of AFS wall panels for lateral loads can satisfactorily be undertaken in accordance with AS3600, modified as noted in the AFS Technical Manual.

Yours faithfully,
Van der Meer Consulting Pty Ltd

Neil Bonser
Managing Director

Fig L2: Lateral Load Resistance of AFS Wall Panels.



Fig L3: Durability Compliance



MAHAFFEY ASSOCIATES PTY LTD (ABN 90 001 629 036)
 Incorporating BEMAC Laboratories
 Unit 9/108-110 Percival Rd (PO Box 2162) Smithfield NSW 2164
 Ph (02) 9756 4003 Fax (02) 9757 4228 Email mahaffey@mahaffey.com.au

DRM/L01/10655

3 November 2014

AFS Systems Pty Ltd
 39 Delhi Rd
NORTH RYDE NSW 2113

Attention : Mr S. Darwell

Dear Sir,

Re : AFS LOGICWALL – AS3600 Durability Compliance Review

1. Introduction

Mahaffey Associates has carried out a review of the AFS LOGICWALL system to assess whether a wall constructed using this system complies with the durability requirements of AS3600, “Concrete Structures”.

The LOGICWALL system is designed for the construction of reinforced or non-reinforced concrete walls. Once constructed, the formwork does not contribute to the structural capacity of the wall which acts as a normal reinforced concrete structure.

2. Discussion

The concrete and reinforcement are encapsulated within the fibre cement shell and coating which together act as a protective barrier. When used in the construction of walls in interior and exterior environments, the presence of the protective barrier enhances the protection against the effects of the prevailing environment.

LOGICWALL walls designed in accordance with AS 3600 will be subjected to environments consistent with a B2 exposure classification. AS3600 states that protective coatings can be taken into account when assigning exposure classification. Accordingly, the coating system plays a significant role in the design of the system in compliance with AS3600. In a typical

Specialist Consultants in
 -Concrete Technology -Structure Condition Assessment -Building Repair Management -Materials Testing -Product Development
Since 1978

Durability Compliance

AFS Systems Pty Ltd
Re : AFS LOGICWALL – AS3600 Durability Review

Page 2 of 2

3 November 2014

environment, the main agent of deterioration is carbonation. Therefore, the coated external skin in combination with concrete cover to the reinforcement, meets the durability and service life requirement of the standard.

The galvanised steel stud framework becomes embedded in concrete. Field evidence has shown that galvanised steel is durable in concrete in the harshest marine environment. In carbonated concrete, galvanized steel is even more resistant to corrosion.

3. *Conclusion*

Walls constructed using the LOGICWALL system comply with AS3600 provided that the concrete strength and cover meet the requirements of the standard for exposure classifications up to and including B2. Additional protection is provided to the concrete and reinforcement as well as to the components of the LOGICWALL system by the specified protective coating.

Yours faithfully,
Mahaffey Associates Pty Ltd



D. R. Mahaffey

Fig L4: AFS Unisearch Report

**UNSW Global**
AUSTRALIA**Unisearch Expert Opinion Services****COMMERCIAL-IN-CONFIDENCE**

Report prepared on behalf of Expert Opinion Services
A business of UNSW Global Pty Limited

AFS WALLING SYSTEMS

for

Colin Biggers & Paisley
Your reference: David Miller

by

Mark Bradford
Scientia Professor & Professor of Civil Engineering
Australian Laureate Fellow,
Centre for Infrastructure Engineering and Safety
Faculty of Engineering,
The University of New South Wales

Date of Issue: 5 May 2014
Our Reference: J085172

Unisearch Expert Opinion Services PO Box 6666 UNSW Sydney NSW 1466 Australia
T: +61 2 9385 5555 | F: +61 2 9385 6555 | E: experts@unisearch.com.au | W: www.unisearch.com.au
Unisearch Expert Opinion Services is a business group of UNSW Global Pty Limited, a not-for-profit provider of education,
training and advisory services and a wholly owned enterprise of the University of New South Wales
UNSW Global Pty Limited ABN 62 086 418 582

Fig L5: FRL Certificate for LW150 Logicwall®

Certificate of Test

No. 1745

"Copyright CSIRO 2004 ©"
Copying or alteration of this report
without written authorisation from CSIRO is forbidden.

This is to certify that the element of construction described below was tested by the CSIRO Division of Manufacturing and Infrastructure Technology in accordance with Australian Standard 1530, Methods for fire tests on building materials, components and structures, Part 4-1997 on behalf of:

Architectural Framing Systems Pty Ltd
29 Prime Drive
SEVEN HILLS NSW

A full description of the test specimen and the complete test results are detailed in the Division's sponsored investigation report numbered FSV 1038.

Product Name: Permanent formwork, load-bearing, reinforced concrete wall system

Description: The specimen comprised a reinforced concrete wall system of dimensions 2980-mm high x 3000-mm wide x 150-mm thick made up of 3 pre-fabricated permanent formwork panels filled with insitu concrete after assembly.


The formwork panels were fabricated from two 2980-mm high x 1200-mm wide x 6-mm thick fibre cement sheets bonded to 10 galvanised C-section metal studs of dimensions 136-mm x 35-mm x 0.6-mm using "AV Syntec" general purpose building glue. The studs were spaced at 100-mm centres and fixed together in a rigid frame. The studs had 90-mm diameter round holes spaced at 150-mm centres for a provision of horizontal reinforcing bars. The panels were fixed to a floor track (galvanised steel C-section) with provision for reinforcing starter bars from a completed floor slab. Succeeding panels were fitted together in a tongue and groove arrangement, and fixed with 9-18 x 20-mm fibrelocs csk rib head screws at 500-mm centres. The wall was reinforced with N12 reinforcing bars at 450-mm centres, horizontally and vertically. Electrical services were installed in the cavity of the wall, that included two general power outlets and associated PVC conduits at 1200-mm centres. The panels were appropriately braced and 32 Mpa concrete 32-10-120 was pumped in through the top openings in 1500-mm layers and trowelled-off when completely filled. The specimen was subjected to an evenly distributed total load of 600 kN. Details of panel construction are shown in drawing numbered 146-01 Issue B, dated 17 December 2003, by LGDS.


The element of construction described above satisfied the following criteria for fire-resistance for the period stated.

Structural Adequacy	-	no failure at 240 applicable
Integrity	-	no failure at 240 applicable
Insulation	-	236 minutes

and therefore for the purpose of Building Regulations in Australia, achieved a fire-resistance level (FRL) of 240/240/180. The FRL is applicable for exposure to fire from either direction.

Testing Officer: Chris Wojcik Date of Test: 25 February 2004
Issued on the 12th day of March 2004 without alterations or additions.


Garry E Collins
Manager, Fire Testing and Assessments

 This laboratory is accredited (Accreditation No. 3632) by the National Association of Testing Authorities, Australia. The tests reported herein have been performed in accordance with its terms of accreditation.


 **CSIRO Manufacturing & Infrastructure Technology**
14 Julius Avenue, Riverside Corporate Park, North Ryde NSW 2113 AUSTRALIA
Telephone: 61 2 9490 5444 Facsimile: 61 2 9490 5555

Fig L6: FRL Certificate for LW120 Logicwall®




<i>Certificate of Test</i>	
No. 2347 "Copyright CSIRO 2011 ©" Copying or alteration of this report without written authorization from CSIRO is forbidden.	
This is to certify that the element of construction described below was tested by the CSIRO Division of Manufacturing and Infrastructure Technology in accordance with Australian Standard 1530, Methods for fire tests on building materials, components and structures, Part 4-2005, Fire-resistance test of elements of construction on behalf of:	
AFS Products Group Pty Ltd 22-24 Sommersville Circuit EMU PLAINS NSW	
A full description of the test specimen and the complete test results are detailed in the Division's sponsored investigation report numbered FSV 1513A.	
PRODUCT NAME	120-mm thick, load-bearing AFS structural wall system.
DESCRIPTION:	<p>The specimen comprised a reinforced concrete wall system 3000-mm high x 3000-mm wide x 120-mm thick made up of three pre-fabricated permanent formwork panels core-filled with concrete after assembly.</p> <p>The pre-fabricated permanent formwork panels, 1200-mm wide x 3000-mm high, comprised two 6-mm thick fibre cement sheets (CSR Waterblock Technology) bonded to the perforated steel stud assembly using AFS Structural Adhesive. The studs, nominally 2900-mm long x 108-mm wide x 35-mm high, with perforations shown in drawing numbered AFS-CSIR-23-11-11, dated 23 November 2011, by Peter Ellsmore & Associates Pty Ltd., were equally spaced over the width of the panel at nominally 140-mm centres. The wall was reinforced with N12 reinforcing bars at 400-mm centres vertically and 600-mm centres horizontally.</p> <p>The panels were appropriately braced and 32 Mpa 120-mm slump concrete was pumped in through the top openings in 1500-mm high layers, and trowelled off when completely filled.</p> <p>A total load of 700 kN was applied to the specimen for the duration of the test.</p>
The element of construction described above satisfied the following criteria for fire-resistance for the period stated	
Structural adequacy	- no failure at 241 minutes
Integrity	- no failure at 241 minutes
Insulation	- 190 minutes
and therefore for the purpose of Building Regulations in Australia, achieved a fire-resistance level (FRL) of 240/240/180. The FRL is applicable for exposure to fire from either direction.	
This certificate is provided for general information only and does not comply with the regulatory requirements for evidence of compliance.	
Testing Officer: Chris Wojcik Date of Test: 23 November 2011 Issued on the 16 th day of December 2011 without alterations or additions.	
 Garry E Collins Manager, Fire Testing and Assessments	
	CSIRO Materials Science and Engineering 14 Julius Avenue, Riverside Corporate Park, North Ryde NSW 2113 AUSTRALIA Telephone: 61 2 9490 5444 Facsimile: 61 2 9490 5555
	This document is issued in accordance with NATA's accreditation requirements

Fig L7: FRL Assessment

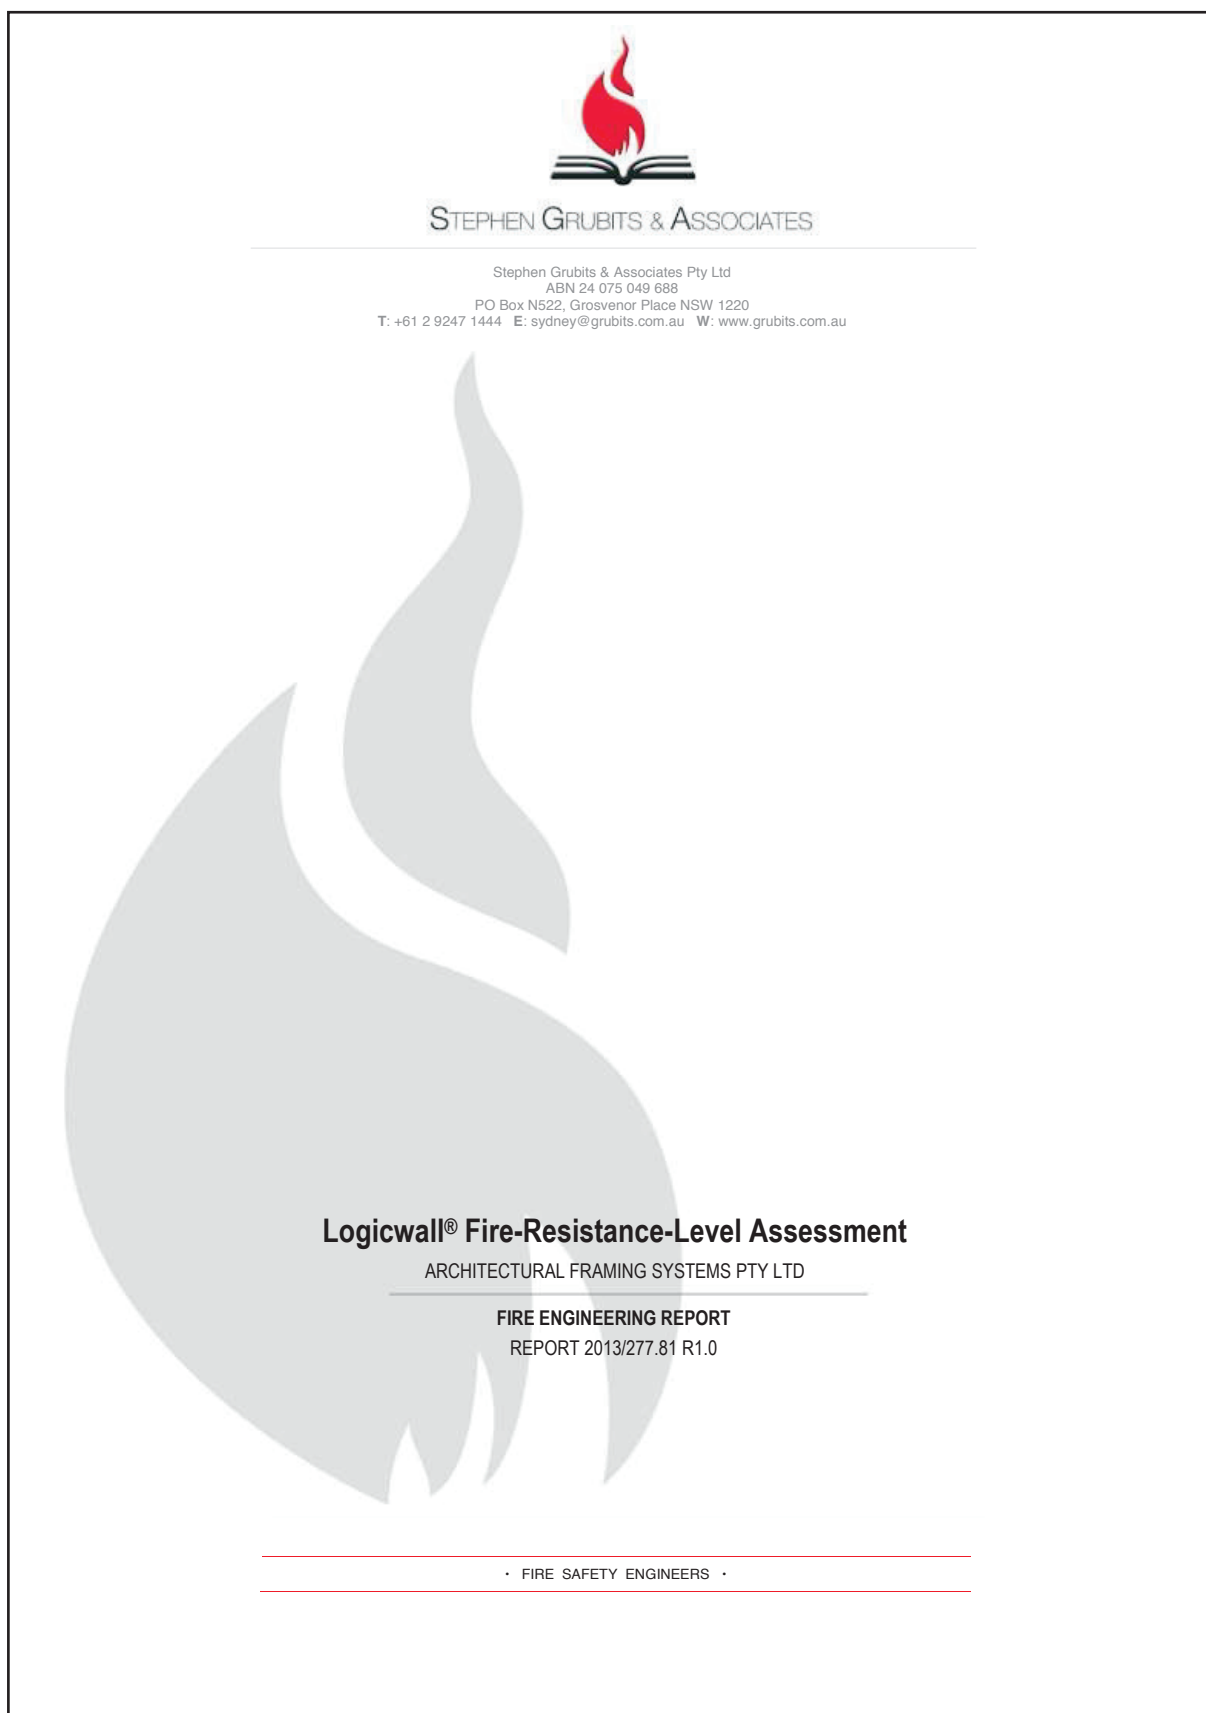


Fig L8: CSIRO Assessment Report

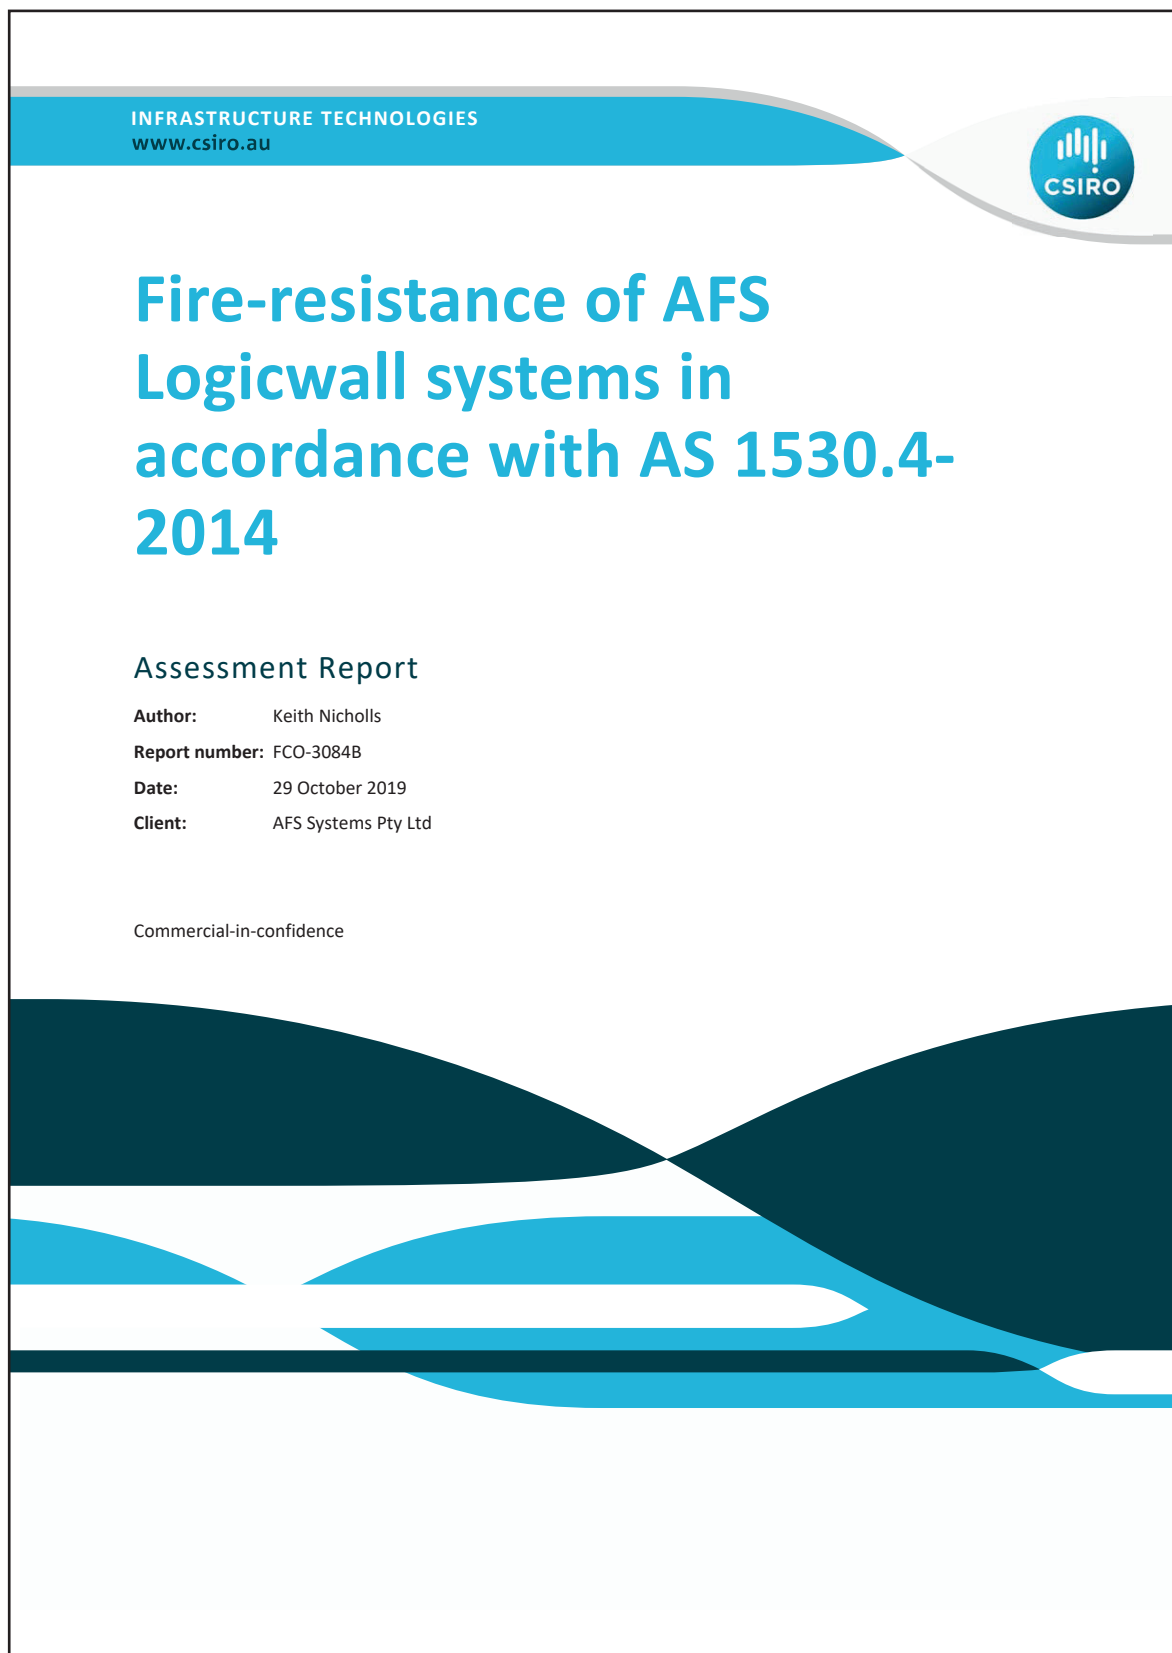



Fig L9: Acoustic Performance Assessment



**Acoustic Performance Assessment
Of a Product or System**

Company Description
AFS Systems Pty Ltd, 2/34-38 Anzac Ave, Smeaton Grange

Product
AFS Logic Wall covering range of AFS120 to AFS262D providing ISO or
ASTM Evaluation of various configurations from the base walls or using
plasterboard on one or both sides

Assessment Number
PKA-A144

Project Number
215 020

Fig L10: Acoustic Performance Assessment

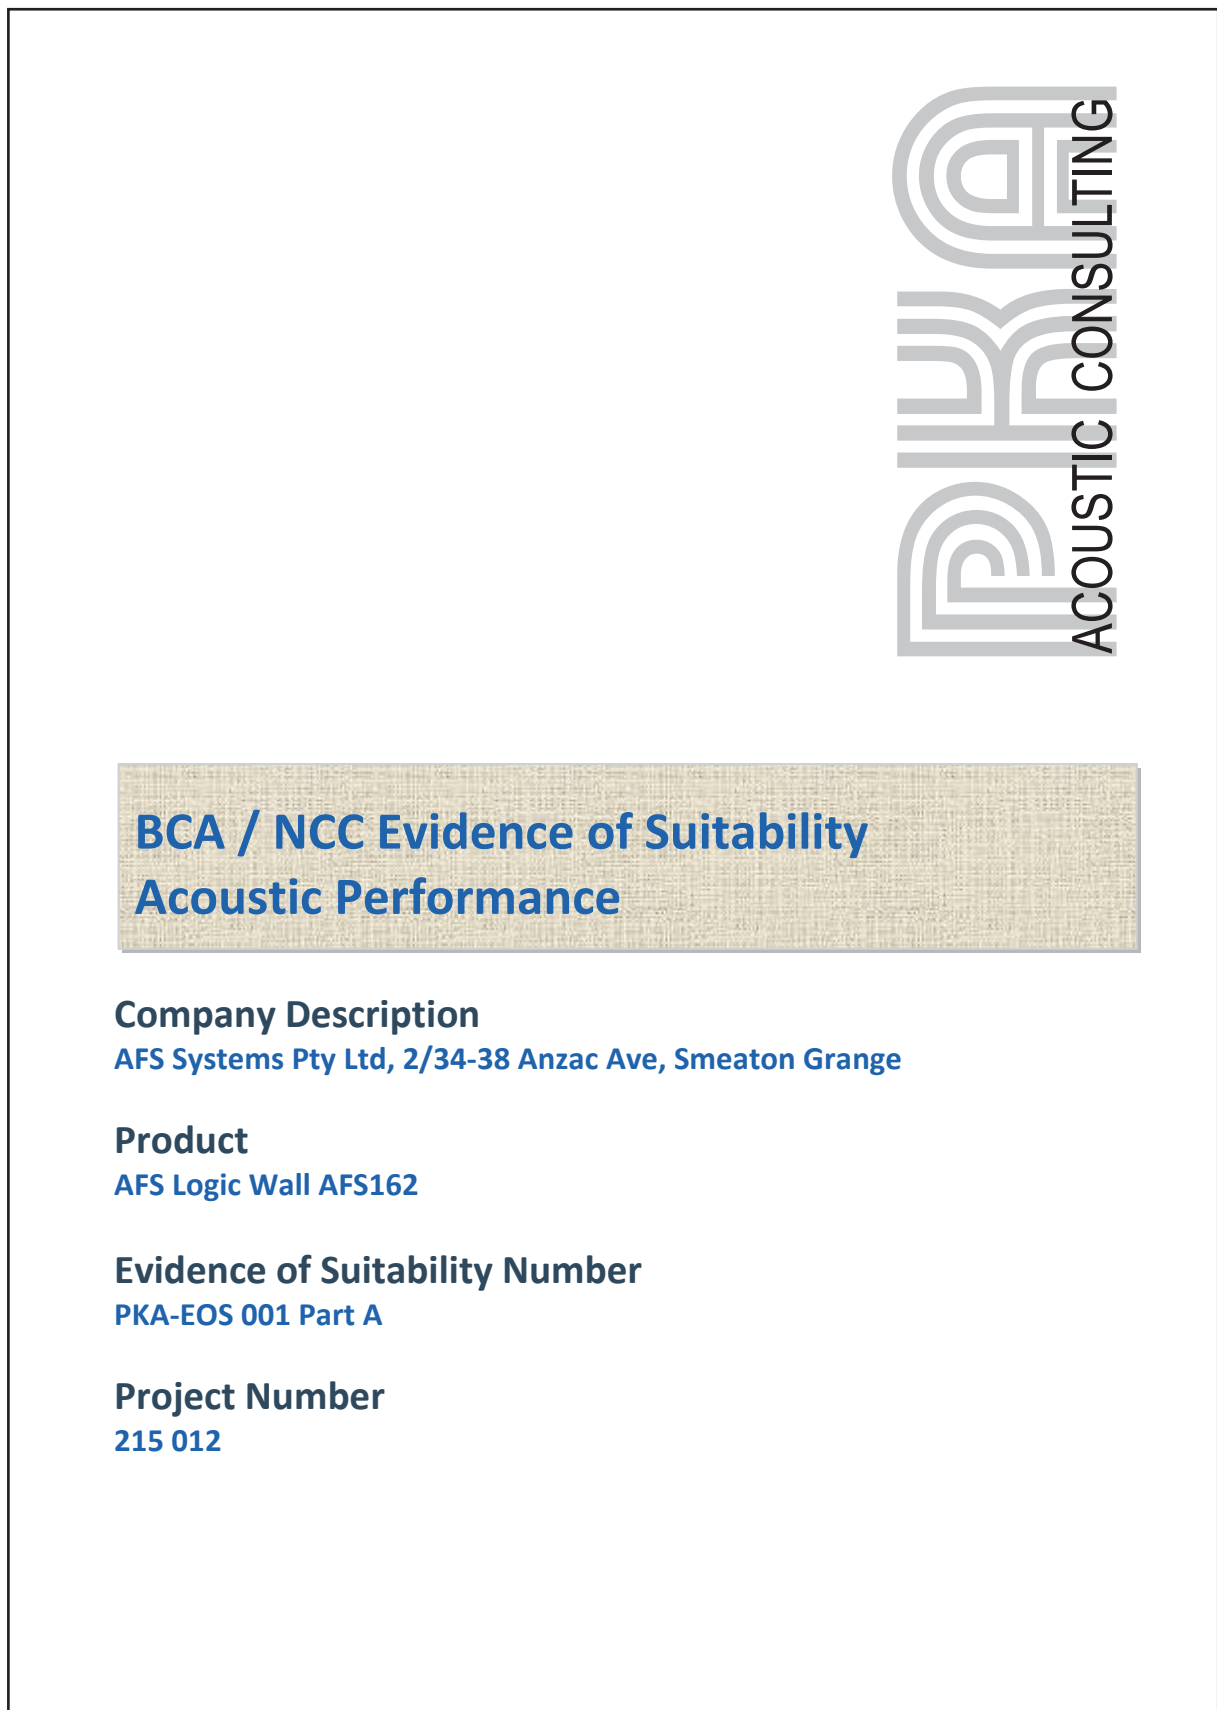



Fig L11: Acoustic Performance Assessment



**BCA / NCC Evidence of Suitability
Acoustic Performance**

Company Description
AFS Systems Pty Ltd, 2/34-38 Anzac Ave, Smeaton Grange


Product
AFS Logic Wall AFS162

Evidence of Suitability Number
PKA-EOS 001 Part B

Project Number
215 012

Fig L12: CSIRO Laboratory Measurement of Airborne Sound Insulation

**CSIRO MANUFACTURING
& INFRASTRUCTURE TECHNOLOGY**
 Graham Road, Highett, Victoria 3190, Australia
Postal Address:
 PO Box 56, Highett, Victoria 3190, Australia
 Telephone 61 3 9252 6000
 Facsimile 61 3 9252 6244



www.cmit.csiro.au

LABORATORY MEASUREMENT OF AIRBORNE SOUND INSULATION

MEASUREMENT NO: TL463

DATE OF MEASUREMENT: 20 - 26 July, 2006

COMMISSIONED BY: Architectural Framing Systems
 29 Prime Drive,
 Seven Hills,
 NSW, 2147.

SUMMARY

The sound transmission loss (*TL*) of a masonry wall; bare and also with two (2) different framing/plasterboard/insulation cladding combinations, has been determined.

The measurement was performed in compliance with the requirements of AS 1191-2002 "*Acoustics - Method for Laboratory Measurement of Airborne Sound Insulation of Building Elements*".

The Sound Transmission Class (*STC*) and the Weighted Sound Reduction Index (*R_w*) of the wall were calculated using the procedures respectively specified by AS 1276-1979 and AS/NZS ISO 717.1:2004.

© 2006 CSIRO
 To the extent permitted by law, all rights are reserved and no part of this publication covered by copyright may be reproduced or copied in any form or by any means except with the written permission of CSIRO.
 While CSIRO takes care in preparing the reports it provides to clients, it does not warrant that the information in this particular report will be free of errors or omissions or that it will be suitable for the client's purposes. CSIRO will not be responsible for the results of any actions taken by the client or any other person on the basis of the information contained in the report or any opinions expressed in it.

CSIRO Manufacturing & Infrastructure Technology has offices in: Melbourne • Sydney • Adelaide • Brisbane **FREECALL 1300 363 400**

Fig L13: Thermal Performance

**“TOTAL R”
THERMAL PERFORMANCE CALCULATIONS
TO AS/NZS 4859 Parts 1 & 2:2018**

The following calculations by James M Fricker Pty Ltd are based upon:

- a) AS/NZS 4859.1:2018 “Thermal insulation materials for buildings. Part 1: General criteria and technical provisions”,
- b) AS/NZS 4859.2:2018 “Thermal insulation materials for buildings. Part 2: Design”,
- c) the Australian Institute of Refrigeration Air-conditioning & Heating (AIRAH) Handbook (Edition 5, 2013), and (if necessary) the ASHRAE Fundamentals Handbook.

Total R-values are based on product in-service conditions in accordance with AS/NZS 4859.1:2018 including the alteration of insulation Material R for temperature, and Air Space R for temperature and infrared emittance.

Each calculation result is subject to any specific notes and assumptions listed on the calculation.

If a construction differs from the described system, the thermal resistance may be different.

All calculations were done by James M Fricker, F.AIRAH F.IEAust CPEng NER APEC Engineer IntPE(Aus)



**ENGINEERS
AUSTRALIA**
Chartered Professional Engineer
MEMBER 1179647



JAMES M FRICKER PTY LTD
54 Felix Crescent
Ringwood North VIC 3134
Australia
Mobile: 0414 804 097
Phone: (03) 9879 5744
fricker@optusnet.com.au
<http://fricker.net.au>

Fig L14: Corefill Compaction Test



Corefill Compaction Test

Conducted on 16/11/2009



1300 727 237

afsformwork.com.au



Corefill Compaction Test (continued)

AFS LOGICWALL CONCRETE COMPACTION TEST

MONDAY 16/11/09

LOCATION: 29 Prime Drive, Seven Hills NSW

PRESENT: Harold Roper / Materials Professor
 Robert Herbertson / Wellstructured Structural Engineers
 Nick Crennan / Colin Biggers & Paisley Lawyers
 Peter Saddington / Coffey International
 Steven Nash / PDR Smart Structures
 AFS (Directors)
 Clyde Daish / HD Projects
 Andrew Bonnette / Bonnette Marketing
 Lenny Casella / Hanson Concrete
 Willy Reinhardt / ANF Concrete Pumping

RECORD OF EVENTS:

MONDAY 16/11/09

11.05am	Concrete arrives (refer docket 50410305). Mixed on site for 1 ½ minutes.
11.10am	Commenced slump test – result 130mm. Added 10 litres water to mix.
11.17am	Another slump test – result 140mm
11.20am	Commenced core filling wall
11.24am	Finish first lift (1600mm) Temperature at 11:30am - 32°C. WAIT BETWEEN LIFTS
11.55am	Another slump test – result 85mm Added 30 litres water & mixed for 5 minutes.
12:04pm	Retest slump – result 110mm Added another 20 litres water & mixed for 4 minutes
12:12pm	Retest slump – result 135mm
12:13pm	Commenced core-filling
12:18pm	Finished second lift.
2:00pm	Commenced stripping the Perspex panels & strips from one of the fibre cement panels
3:30pm	Commenced filming the stripping procedure & the compacted walls
4:15pm	Finish filming stripping procedure & compacted walls

TUESDAY 17/11/09

4.00-5:30pm	Coffey International core-drilled 6 samples from unstripped wall, at base, middle & top of wall.
-------------	--

Corefill Compaction Test (continued)

SLUMP TEST – 140mm



UNFILLED PERSPEX CLAD PANELS



Corefill Compaction Test (continued)

CORE FILLING



STRIPPED PANELS



Corefill Compaction Test (continued)

CORE DRILL TEST PANEL



CORE DRILL SAMPLES



(L-R) Base, Middle & Top of Wall

Corefill Compaction Test (continued)



PROJECTS

P. 02 9999 5288 F. 02 9999 5014
 PO Box 1585 Mona Vale NSW 1660
 16/8 Jubilee Ave Warriewood NSW 2102
www.hdprojects.com.au
 ABN: 84 099 530 588 Lic. 133322C

AFS Products Group
 Att: Dan Arkoll

18th November, 2009

RE: AFS Wall Compaction Test - performed at 29 Prime Drive, Seven Hills 16/11/09

Dear Dan,

We confirm that we were in attendance and assisted with the above test with the following items:

- Supply of boom concrete pump
- Supply of the HD Projects 32/10/120 Wall Mix
- Vibration of the mix being placed.

We confirm that the test that was undertaken, excepting the volume of the test, was an accurate representation of how we would core fill walls on a typical site including vibration of the steel studs and concrete placement.

The concrete we supplied was of a typical consistency of what we would expect on site.

For any queries please do not hesitate to contact me.

AS PER Clyde Daish.

Regards,
 Clyde Daish
 Operations Director

50410305

TAX INVOICE

HANSON CONSTRUCTION MATERIALS PTY LTD
ABN 90 009 679 734

Hanson
HEIDELBERG CEMENT Group

SAFETY ADVICE

1. Wet concrete can be harmful to skin and eyes. Avoid contact by using proper clothing or personal protection in accordance with Australian standards. Wash exposed skin areas thoroughly with cool water for ten minutes.

2. Silica dust may be released when working with quarry products or when quarry or concrete products are broken down. Do not breathe dust. Repeated or continuous long term exposure may lead to lung disease. Always use adequate dust prevention and control measures. Do not use products that conform to Australian standards.

CAUTION

Delivery No. 50410305

Date 16.11.09

Truck PLC2667

Distance 6

Map Ref 189 P1

Job/Order No. T2803017

Plant 3049

Customer No. 126943

ASS

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Tare	Gross	Net/Load	UoM	Class/MPa	Agg	Nominal Slump	Prog Total	Total Order	Ex-Plant
		5.0	M3	S 32	10	120MM	5.0	5.0	10:30
				7N31EBJ		32 MPa			
								Sub Total Inc. GST	\$
								Extra Charges Inc. GST	\$
								Carried Fwd Inc. GST	\$
								TOTAL Inc. GST	\$

Concrete Returned m34Environmental Disposal Fees apply.

Sale Items PMP 32/10/120 HD PROJECTS

WARNING: Addition of water or additives may void product guarantee.

Water Added on Site ☐ Yes ☐ No

Est. Litres: L

Est. Final Slump: mm

Arrive ☐ Finished ☐ W/Tmm

Amt Received ☐ Cash ☐ Chq ☐

\$

Driver Signs for Payment

Plant Signs for Payment

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

LOAD IS TO BE CORRECTLY SLUMPED NO MORE THAN 140MM.

Customer Name: HD PROJECTS PTY LTD

Delivery Address: 29 PRIME DR SEVEN HILLS NSW 2147

NEAREST CROSS RD: SAINT JAMES PL

THIS ORDER IS A TEST TRIAL ORGANISED BY PETRO/CSM/

Corefill Compaction Test (continued)

02/01 2007 23:57 FAX

001

Date in lab		Time in curing		TESTRITE		TEL 9736 3922 FAX 9743 5860					
J.N. 80546	Client 4D PROJECTS PTY			Arrived on site 10.20		Left site 12.30 Hrs.					
	Project Hanson			No. tests done 2		No. cys 3					
	29 PRIME DR SEVEN HILLS			Air contents		MUvs					
	Special instructions			Other work		Shrinkage					
				Pickup details		NEXT TO Wash in car park Right side					
Concrete Supplier (s) Hanson				Site Rep. Clyde Davis		Techs Name & No. (print) Peter S					
Date	Truck No.	Plant code	Grade (Mpa)	Slump initial (mm)	Weather Air & conc. temp. (°C)	Spec. No.	Mould No.	Age at test	Test date	Location of concrete in job.	Remarks
Time ex plant	Time sampled	Docket No	Ordered slump (mm)	Slump final (mm)	Sampling mthd. & Compaction						
		Product code			Pro. total						
16.11		609			Fine	1	239	7	23.11		
09	667			130	28	30	2	240	28/11/12	Carpark	
		SDA10305	532		7.2.1		3	247	28/11/12	test	
										Wall.	
10.30	11.10	2W312EBS	120	140	5.0						
16.11		609			Fine						
09	667			10	28	32				Slump only	
		SDA10305	532		7.2.1						
10.30		2W312EBS	120	135	5.0						

Coring Pty Ltd. 4 Rothwell Ave., PO Box 320, Concord West, NSW 2138. Testing of Concrete, grout, etc, earthworks, masonry, Coring NATA LAB NO. 844 Form C1 Rev. 2, AS 1012 parts 1, 3, 8.1, 8.2, & 13.

JOB NO. 80546

Corefill Compaction Test (continued)

25 Nov 2009 13:40

Hanson

0298971425

p. 1

Fax message

Date 25/11/09
To Clyde
Company HD Projects P/L
Project Prime Dr, Seven Hills
Fax 9999 5014

From Hanson Lab

Subject Test Results
Pages 1 including this one


Hanson

HEIDELBERG

Hanson Construction Materials Pty Ltd

ABN 90 009 679 734

Technical Services Centre

1/29 Crescent Street

Granville

NSW 2142

Tel (02) 8868 1800

Fax (02) 9697 2981

www.hanson.biz

Field Sheet	Specimen	Date Cast	Product Description	Age	Strength MPa
80546	A	16/11/09	ZN31IEBJ	7	39.0

Fig L15: Weatherproofing

AECOM Imagine it.
Delivered.Weatherproofing Verification to NCC 2019
CSR Building Products Limited
13-May-2019

AFS Logicwall System

National Construction Code (NCC 2019)



Fig L16: Lifting Bar Certification



ABN: 36 102 975 600
 Level 2 Suite 201C 19 Harris St, Pyrmont, NSW 2009
 Tel: 02 9817 2611
 Email: info@mydconsulting.com

28th November 2018

Certificate of Structural Design

Client: AFS Systems Pty Ltd

Elements: AFS Lifting Bar

We MYD Consulting Engineers, being professional Engineers in accordance with the Building Code of Australia, certify that the structural details as shown in the structural drawing Nos.

- P2445 S-01/Rev 01 Logicwall Lifting Bar Details,

was prepared by a professional Structural Engineer certified under NER, in accordance with the relevant structural requirements of the BCA, and Australian Standards in particular:

- AS 4100 (1998) - Steel Structures Codes.
- AS 1170 (2011) - Parts 1 Loading Codes.
- AS3610 (1995,2010)-Formwork Design Code.

The AFS report titled – Lifting Bar Test Rev B June 18 was used as a reference document for the verification of the lifting bar capacity

The use of the lifting bar as detailed in the drawings above shall be limited to the following conditions:

- Wind speeds not greater than 15m/s
- Maximum lifting weight 150kg
- Lifting strap located at centroid of load and to be checked to be in satisfactory condition prior to lifting
- Lifting bar undamaged (not bent or kinked)
- EHS practices followed by users of lifting bar
- Ensure the bar has engaged satisfactorily prior to lifting

Lifting Bar Certification (continued)

2

Exclusions:

- Adequacy and certification of Lifting strap used around lifting bar

Any scenarios outside these conditions, MYD consulting shall be consulted for further advice.

This certificate shall not be construed as relieving any other party of their responsibilities.



Peter Marzullo B.Sc, B.E., MIE Aust, CP Eng
For and behalf of
MYD Consulting Engineers.

myd Consulting Engineers

Lifting Bar Certification (continued)

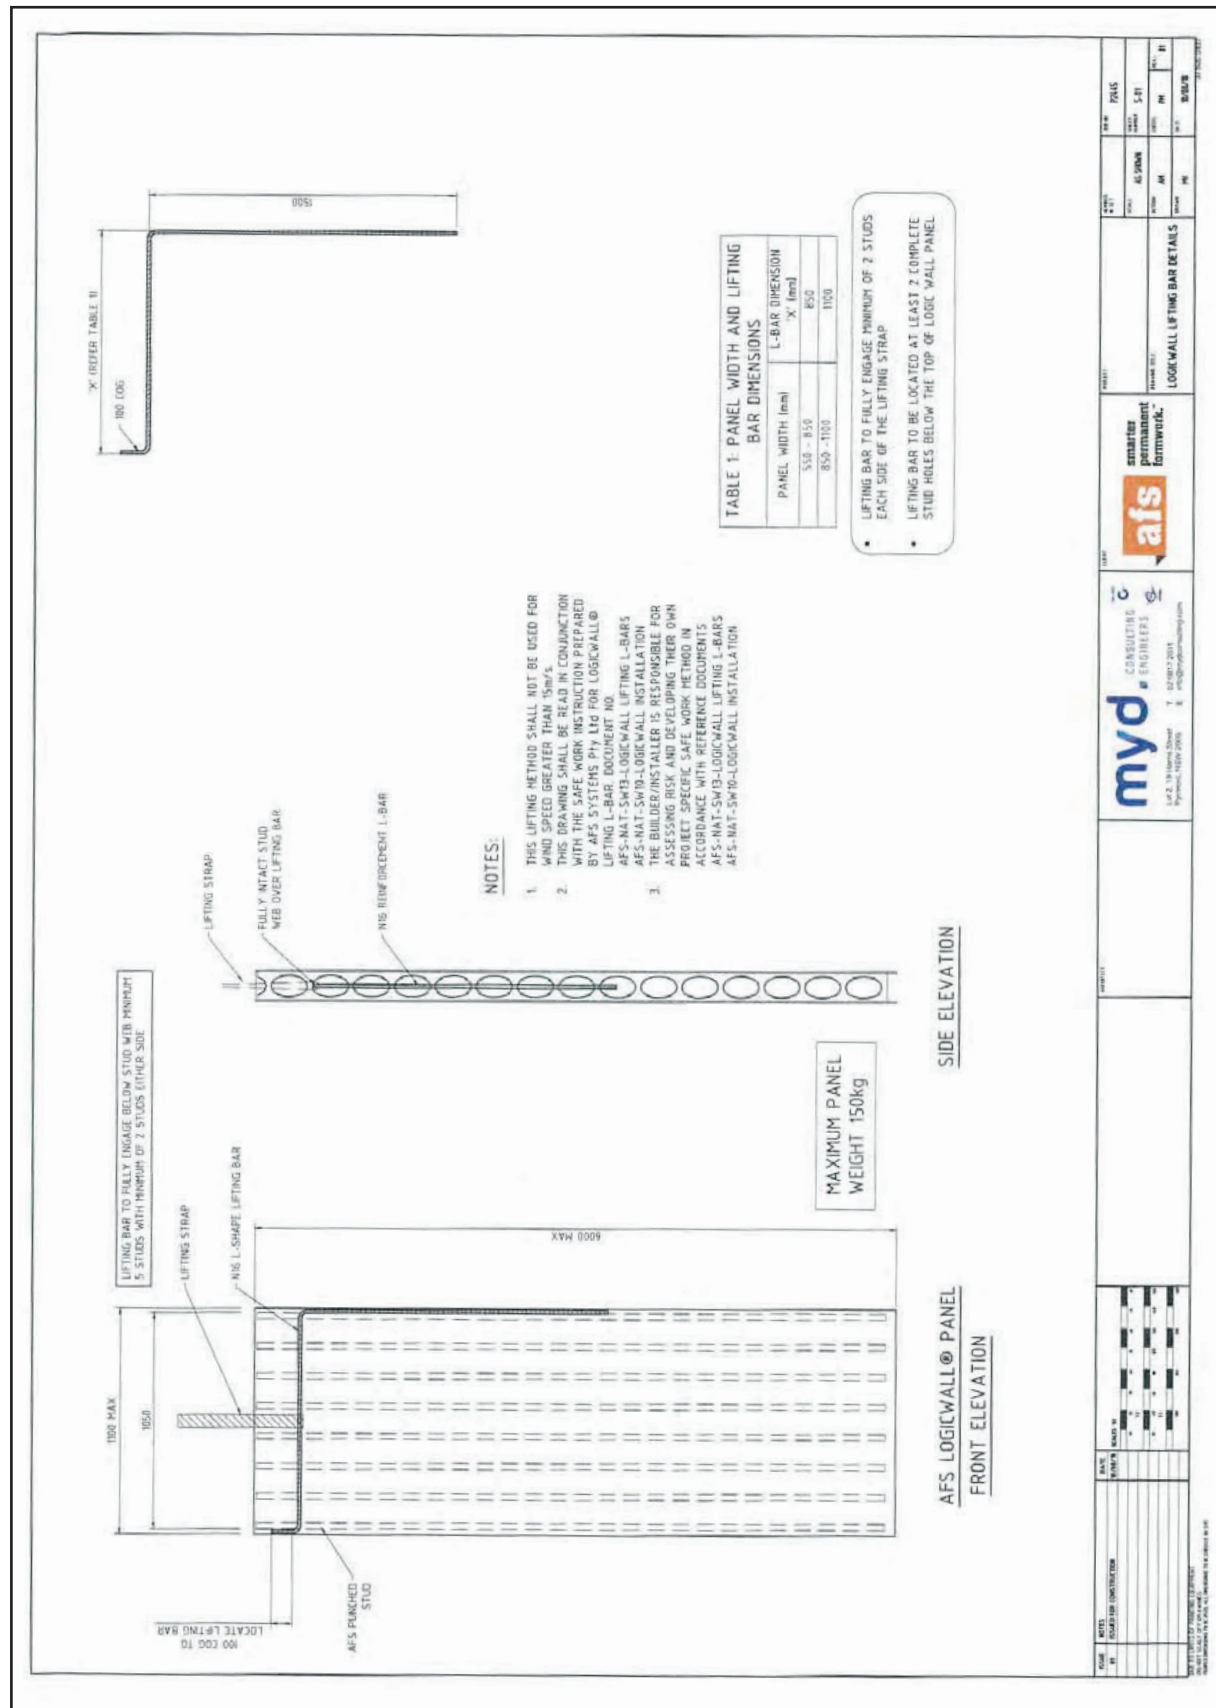


Fig L17: Bracing Design Certification



ABN: 36 102 975 600
 Level 2 Suite 201C 19 Harris St, Pyrmont, NSW 2009
 Tel: 02 9817 2611
 Email: info@mydconsulting.com

11th December 2018

Certificate of Structural Design

Client: AFS Systems Pty Ltd

Elements: AFS Logicwall® Standard Propping Details

We MYD Consulting Engineers, being professional Engineers in accordance with the Building Code of Australia, certify that the structural details as shown in the structural drawing Nos.

- P2351 S-01/Rev D AFS Brace Arrangement Type L1,
- P2351 S-02/Rev D AFS Brace Details Type L1,
- P2351 S-03/Rev D AFS Brace Arrangement Type S1,
- P2351 S-04/Rev D AFS Brace Details Type S1,

Were prepared by a professional Structural Engineer certified under NER, in accordance with the relevant structural requirements of the BCA, and Australian Standards in particular:

- AS 4100 (1998) - Steel Structures Codes.
- AS 1170 (2011) - Parts 1 and 2 Loading Codes.
- AS3610 (1995,2010)-Formwork Design Code.
- AS 2269 (2004)-Structural Plywood Code.
- AS 1720 (2010) - Timber Structures.
- AS 3600(2009) - Concrete design Code.

The use of the propping as detailed in the drawings above shall be limited to the following conditions:

- Region A (non cyclonic)
- Category 3
- Height limited to 8 storeys above surrounding ground level
- The props are to temporarily support the Logicwall formwork only. Based on maximum brace installation period of 4 days.
- All fixings to concrete slab based on the slab having a minimum thickness of 130mm

Bracing Design Certification (continued)

2

Exclusions:

- The prop shall not support backfill behind the wall.
- The structural design and certification of the slabs is by the project engineer
- The structural requirements of the Logic wall to support the structure shall be verified and certified by the project engineer

Any scenarios outside these conditions, MYD consulting shall be consulted for further advice.







This certificate shall not be construed as relieving any other party of their responsibilities.



Peter Marzullo B.Sc, B.E., MIE Aust, CP Eng
For and behalf of
MYD Consulting Engineers.

myd Consulting Engineers

Fig L18: CodeMark Certificate of Conformity

  <p>Global-Mark Pty Ltd, Suite 4/07, 32 Delhi Road, North Ryde NSW 2113, Australia Tel: +61 (0)2 9886 0222 - www.Global-Mark.com.au</p> <p>Certificate Holder: CSR Building Products Ltd - AFS Systems Pty Ltd Triniti 3, 39 Delhi Rd, North Ryde, NSW 2113 www.afsformwork.com.au Tel: 1300 727 237</p>		Certificate number: CM30062 Rev 3	
		THIS TO CERTIFY THAT AFS LOGICWALL®	
Type and/or use of product: AFS LOGICWALL is a permanent formwork system for internal and external load-bearing and non-load bearing reinforced concrete walls with fire, weatherproofing, acoustic and thermal performance characteristics. AFS LOGICWALL® types are as follows, the numerical values representing the thickness of the wall in millimetres, and "D" indicating double layer of reinforcing steel: 1. LW120 2. LW150 3. LW162 4. LW200 5. LW200D 6. LW262D	Description of product: AFS LOGICWALL comprises: <ul style="list-style-type: none"> Galvanised cold-formed steel studs at 146mm centres, the studs having large lipped penetrations in their web element to facilitate placement of reinforcing steel and flow and subsequent bond of concrete fill. CSR Cemintel fmm AFS Formwork Board bonded each side to the flanges of the studs with an adhesive compound. Reinforcing steel. Concrete fill. 		
COMPLIES WITH THE FOLLOWING BCA PROVISIONS AND STATE OR TERRITORY VARIATION(S)			
Performance Requirement(s):		Volume One BP1.1	Volume Two P2.1.1
		Structural reliability	Structural stability and resistance
BCA (2019)			
<p>Scope of certification: The CodeMark Scheme is a building product certification scheme. The rules of the Scheme are available at the ABCB website www.abcb.gov.au. This Certificate of Conformity is to confirm that the relevant requirements of the Building Code of Australia (BCA) as claimed against have been met. The responsibility for the product performance and its fitness for the intended use remain with the certificate holder. The certification is not transferable to a manufacturer not listed on Appendix A of this certificate.</p> <p>Disclaimer: The Scheme Owner, Scheme Administrator and Scheme Accreditation Body do not make any representations, warranties or guarantees, and accept no legal liability whatsoever arising from or connected to, the accuracy, reliability, currency or completeness of any material contained within this certificate; and the Scheme Owner, Scheme Administrator and Scheme Accreditation Body disclaim to the extent permitted by law, all liability (including negligence) for claims of losses, expenses, damages and costs arising as a result of the use of the product(s) referred to in this certificate. The purpose of Global-Mark construction site audits is to confirm the practicability of installing the product; and to confirm the appropriateness and accuracy of installation instructions.</p> <p>In placing the CodeMark mark on the product/system, the certificate holder makes a declaration of compliance with the certification standard(s) and confirms that the product is identical to the product certified herein. In issuing this Certificate of Approval Global-Mark has relied on the expertise of external bodies (laboratories, and technical experts).</p>			
 Herve Michoux Global-Mark Managing Director	 Peter Gardner Unrestricted Building Certifier	Date of issue: 28/11/2019 Date of expiry: 21/01/2022	 
Certificate number: CM30062		This certificate is only valid when reproduced in its entirety.	



Disclaimer: Information presented in this document is supplied in good faith and to the best of our knowledge was accurate at the time of preparation. The provision of this information should not be construed as a recommendation to use any of our products in violation of any patent rights or in breach of any statute or regulation. Users are advised to make their own determination as to the suitability of this

information in relation to their particular purpose or specific circumstances. Since the information contained in this document may be applied under conditions beyond our control, no responsibility can be accepted by AFS or CSR, or its staff for any loss or damage caused by any person acting or refraining from action as a result of misuse of this information.

(C) 2019 AFS Systems Pty Ltd ABN 455 760 727 88

BMS1734.0919



afsformwork.com.au • 1300 727 237

AFS Systems Pty Ltd • 110 Airids Road, Minto NSW 2566

