

Section D Structural Design

Logicwall® Structural Design, Design for Earth Quake Actions,
Non-Ductile Walling, Limited Ductile Walling, Wall Details,
Core Filling of Walls

Contents

Definition of Terms Used in this Section.....	4
D1. Structural Design	5
Introduction.....	5
Wall Properties.....	6
Fire Performance	6
FRP Insulation.....	7
Flexural Capacity	7
Lintels.....	7
Reinforcement Requirements	8
Minimum Reinforcement	8
Reinforcement Detailing Constraints.....	8
D2. LOGICWALL® Design For Earthquake Actions	9
D3. Non Ductile Wall Design.	9
Axial Capacity	9
LW120 Structural Capacities.....	10
LW150 Structural Capacities.....	12
LW162 Structural Capacities.....	14
LW200D Structural Capacities	16
LW262D Structural Capacities	19
D4. Non-Ductile Wall Detailing	22
Junctions.....	22
Standard wall junctions	22
Fig D1: Standard Cross Junction.	23
Fig D2: Standard AFS Open Corner Capping	23
Fig D3: Standard T Junction Capping	23
Fig D4: Standard Hook Bars	23
Fig D5: Standard Angle Junction.	23
Fig D6: Standard Cross Junction.	24
Fig D7: Standard AFS Open Corner Capping	24
Fig D8: Standard T Wall Junction Capping	24
Fig D9: Standard Angle Junction.	24
Fig D10: Standard U Bars	24
Special junctions (where specified by the engineer).....	25
Fig D11: Special Cross Junction	25
Fig D12: Special AFS Open Corner Capping.	25
Fig D14: Standard U Bars	25
Fig D13: Special T Junction Capping	25
Prefabricated Corners	26
Fig D15: Standard L-Bar Factory Installed	26
Fig D16: Standard U-Bar Factory Installed	26
Non-Ductile Blade Walls/Columns.....	27
Joints.....	27
Sheet Surface Joint (Internal Surface Only)	27
Fig D17: Logicwall® Blade Wall	27
Fig D18: Logicwall® Blade Column	27
Fig D19: Logicwall® Sheet Surface Joint	27

Movement Joints	28
Fig D20: Logicwall® Movement joint	28
Fig D21: Logicwall® Corner Joint	28
Fig D22: Logicwall® T joint	28
Construction Joint	29
Fig D23: Logicwall® Construction Joint	29
D5. Limited Ductile Wall Design	30
Limited Ductile Design	30
Fig D24: Sample Moment Interaction	30
Limited Ductile Design Examples	31
Boundary Elements	33
Reinforcement.....	33
Structures not more than four storeys.....	33
Fig D25: AFS Standard Boundary Element Not more than Four Storeys	33
Structures more than four storeys	34
Fig D26: AFS Standard Boundary Element more than Four Storeys	34
Fig D27: AFS Limited Ductile Core Wall Detailing.	35
AFS Limited Ductile Wall Horizontal Reinforcement Wall Laps.....	35
Fig D28: Horizontal Wall Bar Lap Detail - 14.6.7(D)	35
Blade Columns.....	36
Fig D29: Logicwall® Blade Column	36
Junctions.....	36
Fig D30: Special Corner Type 1	36
Fig D31: Special T junction.	36
Fig D32: Special Angle Junction	36
Fig D33: Standard U Bars	36
Movement Joints	37
Fig D34: Logicwall® Movement joint	37
Construction Joint	38
Fig D35: Logicwall® Sheet Surface Joint	38
Wall Junctions Joints.....	38
Fig D36: Logicwall® Corner Joint	38
Fig D37: Logicwall® T joint	38
D6. CORE FILLING OF WALLS	39
Introduction.....	39
Concrete Pour Limitations.....	39
Additional Equipment Required for Concrete Pour	39

Definition of Terms Used in this Section

t_w	Effective structural concrete wall width
$t_{w,fire}$	Effective wall width for fire
S_{web}	Web spacing
S_{punch}	Vertical punch spacing
A_c	Percentage of web opening
Align	Allowance for on-site mis-alignment of web openings
N_{layers}	Number of Reinforcement layers
d_h	Distance to centre of horizontal bar from the Logicwall® concrete face
$f'_{c,max}$	Maximum concrete strength
f_y	Steel yield stress
Bar Max	Max reinforcement bar size
e	The eccentricity of the load measured at right angle to the plane of the wall
H_{wu}	Unsupported wall height
H_{we}	Effective wall height
t_{total}	total wall width
D_{punch}	Horizontal width of punch
A_{stud}	Area stud
I_{xx}	Stud moment of inertia
μ	Structural ductility factor [AS3600-2018]
S_p	Structural performance factor [AS3600-2018]

D1. Structural Design

Disclaimer: The products referred to in this document have been manufactured by or on behalf of CSR Building Products Limited ("CSR") to comply with the relevant sections of the National Construction Code (NCC) and any relevant Australian Standards. While any design or usage guidelines set out in this document have been prepared in good faith by CSR, they are of a general nature only and are intended to be used in conjunction with project specific design and engineering advice.

It is the responsibility of the customer to ensure that CSR's products are suitable for their chosen application, including in respect of project-specific matters such as, but not limited to structural adequacy, acoustic, fire resistance/combustibility, thermal, and weatherproofing requirements. All information relating to design/installation/application of these products is offered without warranty and no responsibility can be accepted by CSR for errors and omissions, or for any use of the relevant products not in accordance with CSR's technical literature or any other relevant industry standards. For current technical and warranty documentation relating to CSR's products, visit the AFS website at www.afsformwork.com.au

Introduction

AFS Logicwall® is a CodeMark certified permanent formwork for load bearing insitu concrete walls. Its lightweight, sandwich panels are created by bonding durable compressed fibre cement sheets to galvanised steel stud frames. This section of the Logicwall® Design Guide provides guidelines for the structural design of walls constructed using Logicwall® and are designed as reinforced concrete walls in accordance with the AS3600 (2018) Concrete Structures Code. The following areas of structural design are discussed in this section:

- Non ductile wall design
- Limited ductile wall design

Non ductile and limited ductile wall design of Logicwall® shall be carried out in accordance with AS3600 (2018)

The Logicwall® system is designed for the construction of both reinforced and non-reinforced concrete walls. Once constructed, the formwork system does not contribute to the structural capacity of the wall, which acts as a normal concrete structure when used and constructed in accordance with AFS Logicwall® manual instructions.

Wall Properties

TABLE D1: Wall Properties

Wall Type	Stud Spacing	t_w	t_{total}	D_{punch}	A.stud	I_{xx}	$A_c\%$	$f_{y,stud}$	EQ Factors	
	(mm)	(mm)	(mm)	(mm)	(mm ²)	(mm ⁴ ×10 ³)		MPa	μ	K_{co}
LW120	146	108	120	70	63.69	164.2	47.1%	300	0.741	0.235
LW150	146	136	148	100	68.09	276.5	52.3%	300	0.756	0.260
LW162	146	150	162	100	75.79	358.4	47.2%	300	0.742	0.236
LW200	146	188	200	134	77.99	602.9	50%	300	0.75	0.25
LW262	146	250	262	211	115.39	1303.5	39.7%	300	0.75	0.25

Fire Performance

TABLE D2: FRL by CSIRO Fire Test

FRL by testing and assessment to AS1530.4

Type	t_{fire}	$H_{w,max}$	N^*_{max}	FRL
	(mm)	(mm)	(kN/m)	(Ade/Int/Ins)
LW120	120	3000	233	240/240/180*
LW150	145	3000	233	240/240/180**
LW162	160	3000	233	240/240/240***
LW200D	200	3000	233	240/240/240***
LW262D	260	3000	233	240/240/240***

*FRL Determined by CSIRO Fire Test Number FSV1513A with minimum reinforcement.
 **FRL determined by CSIRO Fire Test Number FSV1038 with minimum reinforcement.
 ***FRL determined by CSIRO Fire Assessment Report FCO-3084B.

FRL by AS3600-2018

Where design is outside the limits given in the above table FRL shall be determined in accordance with AS 3600-2018.

Where calculating structural capacity for a fire load the area of the exposed stud flange is to be excluded

TABLE D3: AS3600 FRL (Ade/Int/Ins#2) – Exposed 1 Side

	Cl 5.8.1#1	30/30/180	60/60/180	90/90/180	120/120/180	180/180/240	240/240/240
Wall	t_{fire}	$N^*f/\phi N_u$	$N^*f/\phi N_u$	$N^*f/\phi N_u$	$N^*f/\phi N_u$	$N^*f/\phi N_u$	$N^*f/\phi N_u$
LW120	120	0.70	0.53	0.35	0.18		
LW150	145	0.70	0.70	0.70	0.25		
LW162	160	0.70	0.70	0.70	0.70		
LW200/ LW200D	200	0.70	0.70	0.70	0.70	0.58	
LW262D	260	0.70	0.70	0.70	0.70	0.70	0.62
LW262D	260	0.70	0.70	0.70	0.70	0.70	0.62

#1 Cl 5.8.1: $t_{fire} = t_w + t_{FCsheet}$ rounded up to the nearest 5mm
 #2 FRP Based on CSIRO Fire Tests

FRP Insulation

FRP for Insulation in the previous tables is determined by CSIRO testing for walls less than LW200 and in accordance with AS3600-2018 Table 5.7.1 for walls greater than LW200.

Electrical boxes, chases or other hollows in walls must maintain a minimum separation and concrete thickness as given in the AS3600-2018 FRP Insulation Table below.

TABLE D4: Fire Resistance Periods (FRPs) for walls for insulation

FRP for installation (min)	Effective thickness (mm)
30	60
60	80
90	160
120	120
180	150
240	175

Flexural Capacity

The flexural strength of Logicwall® is obtained by the stud flanges acting as reinforcement therefore from classic beam theory ignoring axial forces and any vertical reinforcement:

$$\phi M_u = f_{\text{stud}} t_w A_{\text{flange}} \left(1 - 0.6 \frac{A_{\text{flange}}}{b t_w} \frac{f_{\text{stud}}}{f'_c} \right)$$

Where:

- $\phi = 0.8$ strength reduction factor
- M_u ultimate flexural capacity
- f_{stud} yield strength of vertical studs
- A_{flange} area of stud flange
- f'_c characteristic compressive strength of concrete

Since the stud flanges are potentially exposed to fire they can only be used for wind loads in accordance with AS/NZS1170.2.

If flexural capacity other than wind loads is required then the wall may be reinforced and designed as a normal reinforced concrete wall.

Lintels

Lintel tables have been prepared based on a wall with minimum reinforcement for bending and shear capacity. If additional capacity is required, extra reinforcement can be designed and detailed by the engineer.

Reinforcement Requirements

The individual cells within AFS Logicwall® allow horizontal shrinkage and thermal movements in the concrete with the internal studs acting as crack inducers. This allows AFS Logicwall® to provide crack control without additional reinforcement. The vertical studs can be considered as non fire-rated vertical reinforcement.

For fire-rated reinforced walls to AS3600-2018 Cl11.7.1 use minimum vertical reinforcement ratio (ρ_v)

of 0.0015 or the value required by structural analysis.

Due to the presence of the steel studs in AFS Logicwall® steel congestion should be avoided to facilitate adequate compaction of concrete. As a guide steel ratios in excess of 0.02 in a single layer should not be used unless the amount and disposition of the reinforcement will not prevent the proper placement and compaction of the concrete at splices and at junctions of members.

Minimum Reinforcement

For walls required to have tensile forces from any load combination AS3600-2018 11.7 Minimum reinforcement shall apply.

Examples of such walls are:

- Walls resisting lateral loads
- Walls acting as deep beams
- Walls with load combinations of bending and compression producing tension stress.
- Where reinforced AFS Logicwall® walls do not require a high degree of crack control for tensile forces we recommend a minimum reinforcement spacing of 400mm.

Notes: AS3600 does not recognise the use of plain concrete in wall elements, though some International standards offer guidance in this area. Use of AFS Logicwall® walls unreinforced will require reference to other codes such as ACI 318 and BS8110.1 where it can be shown that no tensile forces result from any load combination of bending and compression.

TABLE D5: Minimum Reinforcement for Reinforced Walls (ρ) = A_{st}/A_{conc}

Location	Vertical (ρ)	Horizontal (ρ)
Internal (A1, A2)	0.0025 (0.0015 Cl.11.7.1(a))	0.0015
External (B1, B2)	0.0025 (0.0015 Cl.11.7.1(a))	0.0025
Limited Ductile	0.0025	0.0025
Deep Beam	AS3600 Sect 12	AS3600 Sect 12

Steel ratios in excess of 0.02 should not be used unless the amount and disposition of the reinforcement will not prevent the proper placement of the concrete in walls and at splices and junction members.

Reinforcement Detailing Constraints

For heavily loaded walls where reinforcement ratio is high, it is critical that reinforcement is detailed carefully to avoid congestion within the wall which creates difficulties when core filling and may result in voids or insufficient concrete compaction.

When detailing reinforcement to be placed in Logicwall® the following spacing constraints must be noted:

- For single reinforcement carrier walls the reinforcement is centrally placed at minimum horizontal centres.

- For double reinforcement carrier walls, LW200D and LW262D, the reinforcement is located toward each face of the wall with concrete cover as shown.
- Typical total reinforcement rates are less than 0.01. Rates in excess of 0.02 are not recommended as it creates possible congestion issues.
- Areas with higher reinforcement concentrations such as laps and corners should be reviewed.

D2. LOGICWALL® Design For Earthquake Actions

Logicwall® is to be designed to cater for earthquake actions as per AS1170.4 Earthquake Actions and AS3600-2018 Section 14 Design for Earthquake Actions. The design and detailing of the wall will depend on the Structural System selected by the designer for

the building from AS3600 – 2018, Table 14.3 Structural Ductility Factor and Structural Performance Factor. This will normally be either Non-Ductile Structural Walls or Limited Ductile Structural Walls.

D3. Non Ductile Wall Design

The use of the Simplified Design Method in AS3600 – 2018 Section 11.5 is limited to Non-Ductile Walls by Cl 14.4.4.1 and Cl 11.5.2 Limitations on the use of the Method. Non-Ductile Logicwall® are to be designed to Section 2.2 and 14.4, with clause 14.4.4.1 stating "Walls shall be designed in accordance with Section

10 or Section 11 as appropriate except that the simplified design method for walls subjected to vertical compression forces provided in Clause 11.5 of this standard shall only be used for non-ductile walls."


Axial Capacity

AFS Logicwall® can be designed in accordance with Section 11 of AS3600 – 2018.

$$\phi N_u = \phi(t_w - 1.2e - 2e_a)0.6f_c \quad [\text{AS3600 Cl.11.5.3}]$$

Where:

- $\phi = 0.65$ strength reduction factor
- $N_u =$ ultimate strength per unit wall length
- $t_w =$ thickness of the wall
- $e =$ eccentricity of the load measured at right angles to the plane of the wall
- $e_a = \frac{H_{we}^2}{2500t_w}$ an additional eccentricity
- $H_{we} = kH_{wu}$ effective height of a braced wall

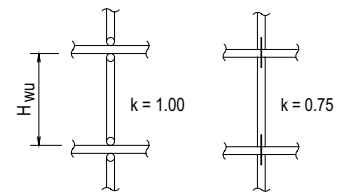

[AS3600 Cl.11.5.3]

11.5.2 Limitation on use of method


"Structural walls designed using Clause 11.5.3 Shall –

- (a) be limited to a maximum design axial stress of 3 MPa unless vertical and horizontal reinforcement is provided on both wall faces and divided equally between the two wall faces;
- (b) not constructed on sites with soil classifications of De or Ee, as defined in AS 1170.4, and where subjected to earthquake design actions; and
- (c) have a ratio of effective height to thickness that does not exceed 20 for singly reinforced wall or 30 for doubly reinforced walls.

Otherwise, the wall shall be designed as a column in accordance with Section 10."

D3.1. LOGICWALL® LW120

LW120 Structural Capacities

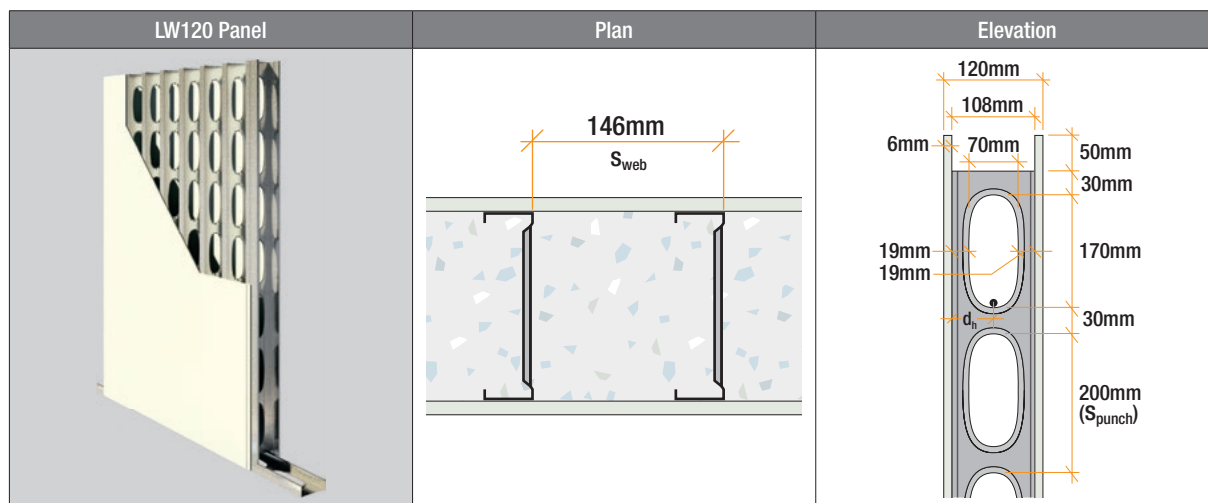

LW120 Axial Capacity ϕN_u (kN/m)

t_w	S_{web}	S_{punch}	A_c	N_{layers}	d_h	$f'_{c,max}$	Slend. Limit	Max. H_{wu}
108	146	200	47%	1	54	40	20	2880

$k = 0.75$		$e \leq 1/6t_w$		
H_{wu}	H_{we}	25 MPa	32 MPa	40 MPa
2880	2160	324*	324*	324*
Bearing capacity at standard bottom plate		1001	1281	1601

*AS3600-2018 Section 11.5.2 Limitations on use of Simplified Design Method

LW120 Reinforcement

LW120		Vertical Bars (min. N12 - 350)			
Allowable Bars		N12	N16	N20	N24
Horizontal Bars (min. N12 - 350)	N12	Acceptable	With Caution	Not Recommended	Not Recommended
	N16	Not Recommended	Not Recommended	Not Recommended	Not Recommended
	N20	Not Recommended	Not Recommended	Not Recommended	Not Recommended
	N24	Not Recommended	Not Recommended	Not Recommended	Not Recommended

Horizontal Bar Spacing 200/300*/400

Vertical Bar Spacing 150 to 350

$f'_{c,max}$ 40 MPa, Concrete mix as per spec

*Average spacing

Acceptable
With Caution
Not Recommended


LW120 Flexural Capacity

	Non Fire Rated Flexural Capacity, stud only		
	25 MPa	32 MPa	40 MPa
ϕM_u (kNm/m)	12.5	12.6	12.7

Non fire rated capacity, for local wind loads only (ignoring any extra reinforcement)

LW120 Standard Lintels

Capacity given is for standard lintel, with minimum reinforcement and not ties. Engineer can achieve higher capacity by detailing additional reinforcement.

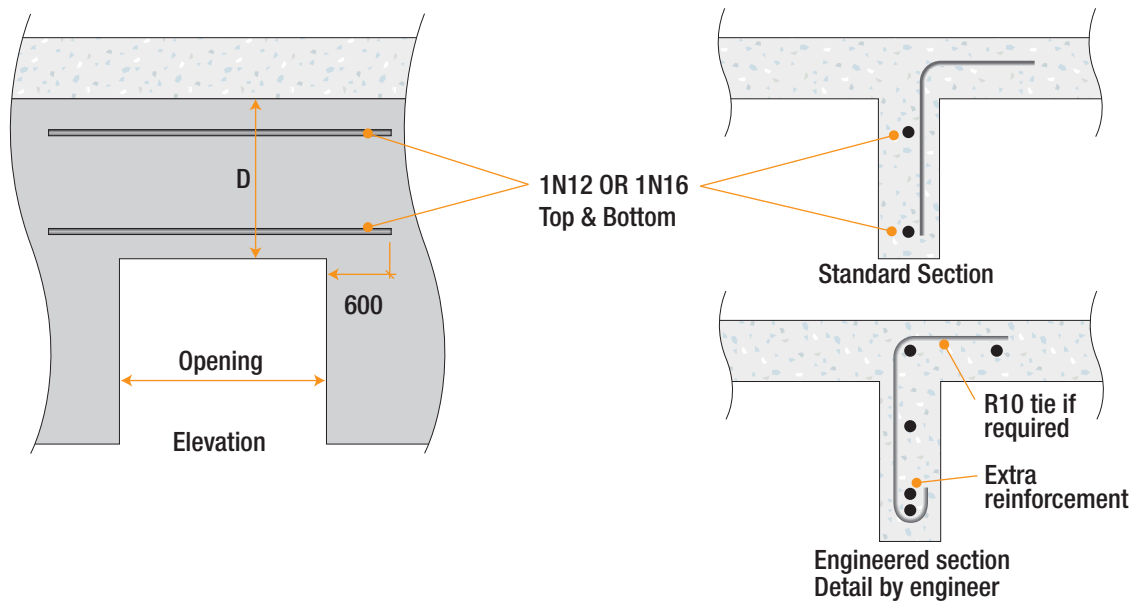


LW120 Standard Lintels with Vertical Studs UDL w^* (kN/m)

	1N12 Top & Bottom, Depth (mm)					1N16 Top & Bottom, Depth (mm)				
D	300	450	600	900	1200	300	450	600	900	1200
d _{eff}	200	350	500	800	1100	200	350	500	800	1100
Span (mm)										
3900	6.0	10.7	15.5	25.1	34.6	10.3	19.0	27.6	41.5	41.5
3600	7.0	12.6	18.2	29.4	38.0	12.1	22.3	32.4	45.0	45.0
3300	8.3	15.0	21.7	35.0	41.4	14.4	26.5	38.6	49.1	49.1
3000	10.1	18.2	26.2	38.7	45.6	17.4	32.0	46.7	54.0	54.0
2700	12.5	22.4	32.4	43.0	50.6	21.5	39.6	53.9	60.0	60.0
2400	15.8	28.4	39.8	48.4	57.0	27.2	50.1	60.6	67.5	67.5
2100	20.6	37.1	45.5	55.3	65.1	35.5	64.4	69.3	77.1	77.1
1800	28.1	47.3	53.1	64.5	75.9	48.3	75.1	80.9	90.0	90.0
1500	40.4	56.8	63.7	77.4	91.1	69.5	90.2	97.0	108.0	108.0
1200	62.4	71.0	79.6	96.7	113.9	104.1	112.7	121.3	135.0	135.0
900	83.2	94.7	106.1	129.0	151.9	138.8	150.3	161.7	180.0	180.0
ØM _u (kNm/m)	8.3	14.9	21.5	34.7	47.9	14.2	26.2	38.2	62.2	86.2
V _{u,max} (kN)	108.0	189.0	270.0	432.0	594.0	108.0	189.0	270.0	432.0	594.0
ØV _u (kN)	37.4	42.6	47.7	58.0	68.3	62.5	67.6	72.8	81.0	81.0
	f _c ' = 25MPa, 50 cover (min)					f _c ' = 25MPa, 50 cover (min)				
	= Limited by shear									

Based on testing (Refer report No C2004-02, titled "Lateral load resistance of AFS wall panels" by University of Centerbury, New Zealand) with $\phi_{bend} = 0.8$, $\phi_{shear} = 0.7$ and k_{co} against steel = 0 as per clause 8.4.3 of AS3600-2018

D3.2. LOGICWALL® LW150

LW150 Structural Capacities

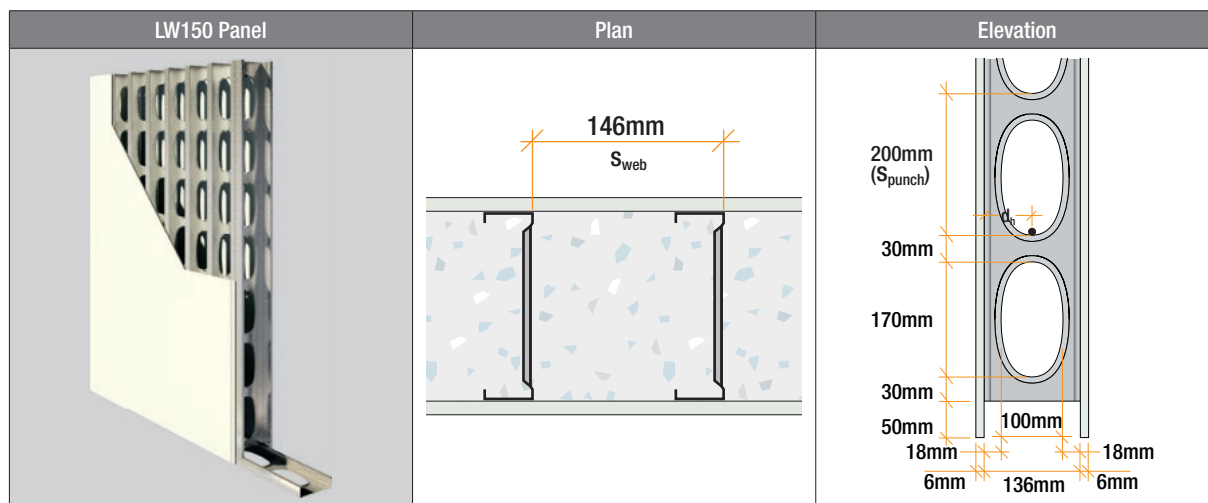

t_w	S_{web}	S_{punch}	A_c	N_{layers}	d_h	$f'_{c,max}$	Slend. Limit	Max. H_{wu}
136	146	200	52%	1	69	50	20	3630

LW150 Axial Capacity ϕN_u (kN/m)

$k = 0.75$		$e \leq 1/6t_w$			
H_{wu}	H_{we}	25 MPa	32 MPa	40 MPa	50 MPa
3630	2720	408*	408*	408*	408*
Bearing capacity at standard bottom plate		1328	1700	2124	2656

*AS3600-2018 Section 11.5.2 Limitations on use of Simplified Design Method

LW150 Reinforcement

LW150		Vertical Bars (min. N12 - 325)			
Allowable Bars		N12	N16	N20	N24
Horizontal Bars (min. N12 - 350)	N12	Acceptable	Acceptable	With Caution	Not Recommended
	N16	Acceptable	With Caution	Not Recommended	Not Recommended
	N20	Not Recommended	Not Recommended	Not Recommended	Not Recommended
	N24	Not Recommended	Not Recommended	Not Recommended	Not Recommended

Horizontal Bar Spacing 200/300*/400

Vertical Bar Spacing 150 to 350

$f'_{c,max}$ 40 MPa, Concrete mix as per spec

*Average spacing

Acceptable
With Caution
Not Recommended


LW150 Flexural Capacity

	Non Fire Rated Flexural Capacity, stud only			
	25 MPa	32 MPa	40 MPa	50 MPa
ϕM_u (kNm/m)	15.9	16.0	16.0	16.1

Non fire rated capacity, for local wind loads only (ignoring any extra reinforcement)

LW150 Standard Lintels

Capacity given is for standard lintel, with minimum reinforcement and no ties engineer can achieve higher capacity by detailing additional reinforcement.

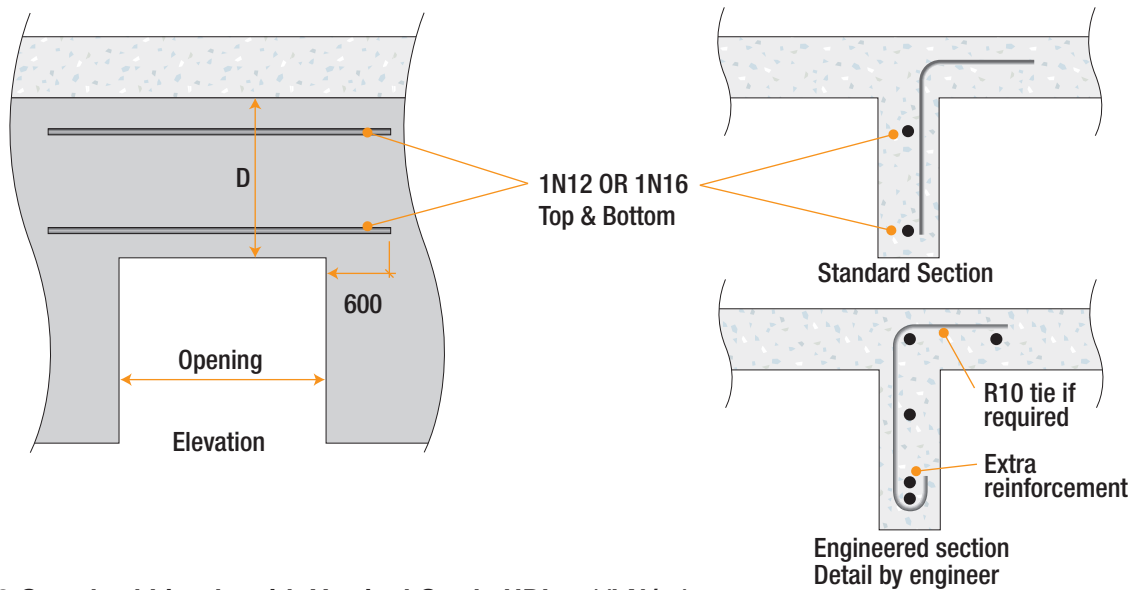


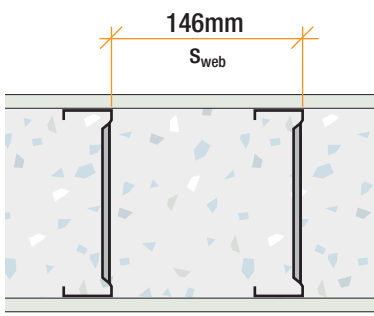
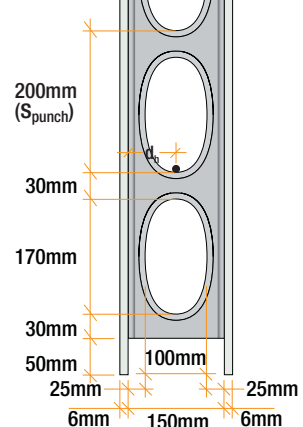
LW150 Standard Lintels with Vertical Studs UDL w^* (kN/m)

	1N12 Top & Bottom, Depth (mm)					1N16 Top & Bottom, Depth (mm)				
D	300	450	600	900	1200	300	450	600	900	1200
d _{eff}	200	350	500	800	1100	200	350	500	800	1100
Span (mm)										
3900	6.1	10.8	15.6	25.1	34.7	10.6	19.2	27.9	45.3	52.3
3600	7.1	12.7	18.3	29.5	40.7	12.4	22.6	32.8	52.9	56.7
3300	8.5	15.1	21.8	35.1	48.5	14.7	26.9	39.0	57.7	61.8
3000	10.2	18.3	26.4	42.5	56.0	17.8	32.5	47.2	63.5	68.0
2700	12.6	22.6	32.6	51.6	62.2	22.0	40.1	58.2	70.5	75.6
2400	16.0	28.6	41.2	58.0	70.0	27.9	50.8	67.3	79.3	85.0
2100	20.9	37.3	52.6	66.3	80.0	36.4	66.3	76.9	90.6	97.1
1800	28.4	50.8	61.4	77.4	93.4	49.5	81.7	89.7	105.8	113.3
1500	40.9	64.0	73.6	92.8	112.0	71.3	98.1	107.7	126.9	136.0
1200	64.0	80.0	92.0	116.1	140.1	110.6	122.6	134.6	158.6	170.0
900	90.7	106.7	122.7	154.7	186.7	147.5	163.5	179.5	211.5	226.7
ØM _U (kNm/m)	8.4	15.0	21.6	34.8	48.0	14.6	26.6	38.6	62.6	86.6
V _{u,max} (kN)	136.0	238.0	340.0	544.0	748.0	136.0	238.0	340.0	544.0	748.0
ØV _U (kN)	40.8	48.0	55.2	69.6	84.0	66.4	73.6	80.8	95.2	102.0
	f' _c = 25MPa, 50 cover (min)					f' _c = 25MPa, 50 cover (min)				
	= φV _{uc} governs, otherwise φM _U									

Based on testing (Refer report No C2004-02, titled "Lateral load resistance of AFS wall panels" by University of Centerbury, NewZealand) with $\phi_{bend} = 0.8$, $\phi_{shear} = 0.7$ and k_{co} against steel = 0 as per clause 8.4.3 of AS3600-2018

D3.3. LOGICWALL® LW162

LW162 Structural Capacities

LW162 Panel	Plan	Elevation						
								
t_w	S_{web}	S_{punch}	A_c	N_{layers}	d_h	$f'_{c,max}$	Slend. Limit	Max. H_{wu}
150	146	200	47.2%	1	75	50	20	4000

LW162 Axial Capacity ϕN_u (kN/m)

$k = 0.75$		$e \leq 1/6 t_w$			
H_{wu}	H_{we}	25 MPa	32 MPa	40 MPa	50 MPa
4000	3000	450*	450*	450*	450*
Bearing capacity at standard bottom plate		1391	1781	2226	2782

*AS3600-2018 Section 11.5.2 Limitations on use of Simplified Design Method (3MPa)

LW162 Reinforcement

LW162		Vertical Bars (min. N12 - 300)			
Allowable Bars		N12	N16	N20	N24
Horizontal Bars (min. N12 - 350)	N12	Acceptable	Acceptable	Acceptable	Not Recommended
	N16	Acceptable	Acceptable	With Caution	Not Recommended
	N20	Not Recommended	Not Recommended	Not Recommended	Not Recommended
	N24	Not Recommended	Not Recommended	Not Recommended	Not Recommended

Horizontal Bar Spacing 200/300*/400

Vertical Bar Spacing 150 to 350

$f'_{c,max}$ 50 MPa, Concrete mix as per spec

*Average spacing

Acceptable
With Caution
Not Recommended


LW162 Flexural Capacity

	Non Fire Rated Flexural Capacity, stud only			
	25 MPa	32 MPa	40 MPa	50 MPa
ϕM_u (kNm/m)	17.6	17.7	17.7	17.8

Non fire rated capacity, for local wind loads only (ignoring any extra reinforcement)

LW162 Standard Lintels

Capacity given is for standard lintel, with minimum reinforcement. Engineer can add extra reinforcement to achieve higher capacity.

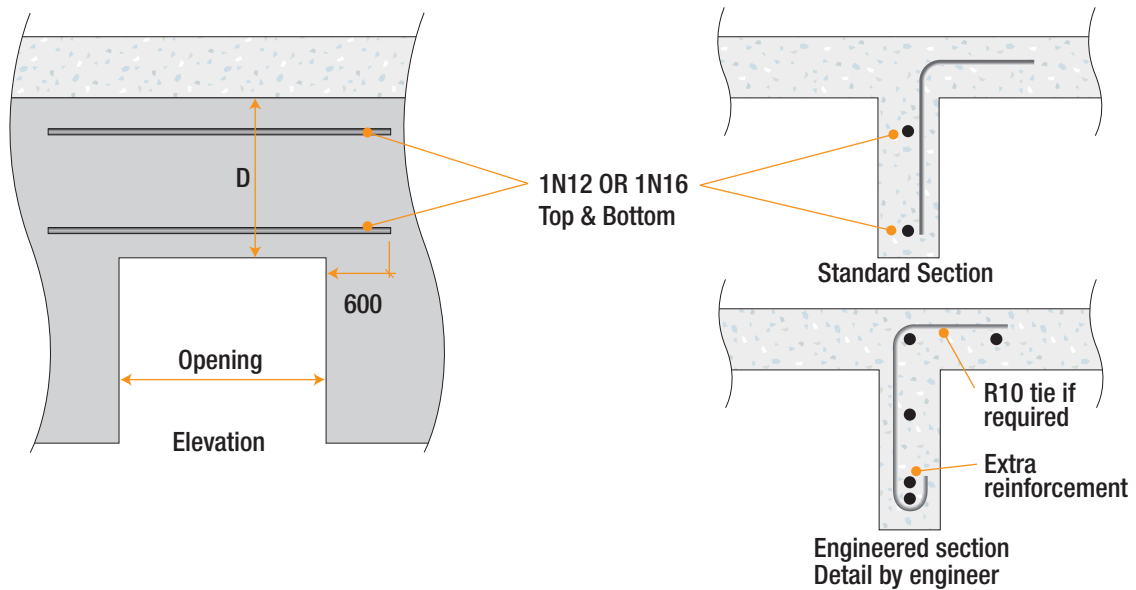


LW162 Standard Lintels with Vertical Studs UDL w^* (kN/m)

	1N12 Top & Bottom, Depth (mm)					1N16 Top & Bottom, Depth (mm)				
D	300	450	600	900	1200	300	450	600	900	1200
d _{eff}	200	350	500	800	100	200	350	500	800	100
Span (mm)										
3900	6.1	10.9	15.6	25.2	34.7	10.6	19.3	28.0	45.4	55.5
3600	7.1	12.7	18.3	29.5	40.8	12.5	22.7	32.9	52.1	60.1
3300	8.5	15.2	21.8	35.2	48.5	14.9	27.0	39.1	56.9	65.6
3000	10.3	18.3	26.4	42.5	55.4	18.0	32.7	47.3	62.6	72.1
2700	12.7	22.7	32.6	51.0	61.6	22.2	40.3	58.4	69.5	80.1
2400	16.1	28.7	41.3	57.4	69.3	28.1	51.0	66.3	78.2	90.2
2100	21.0	37.4	51.9	65.5	79.2	36.7	66.6	75.7	89.4	103.0
1800	28.6	51.0	60.5	76.5	92.4	50.0	80.4	88.4	104.3	120.2
1500	41.1	63.1	72.6	91.8	110.9	72.0	96.5	106.0	125.1	144.3
1200	64.3	78.9	90.8	114.7	138.6	108.6	120.6	132.5	156.4	180.3
900	89.2	105.2	121.1	152.9	184.8	144.8	160.8	176.7	208.6	240.4
ØM _u (kNm)	8.4	15.0	21.6	34.8	48.0	14.7	26.7	38.7	62.7	86.7
V _{u,max} (kN)	150.0	262.5	375.0	600.0	825.0	150.0	262.5	375.0	600.0	825.0
ØV _u (kN)	40.1	47.3	54.5	68.8	83.2	65.2	72.3	79.5	93.9	108.2
	f' _c = 25MPa, 50 cover (min) for all w* tables					f' _c = 25MPa, 50 cover (min) for all w* tables				
	= φV _{uc} governs, otherwise φM _u									

Based on testing (Refer report No C2004-02, titled "Lateral load resistance of AFS wall panels" by University of Centerbury, New Zealand) with $\phi_{bend} = 0.8$, $\phi_{shear} = 0.7$ and k_{co} against steel = 0 as per clause 8.4.3 of AS3600-2018

D3.4. LOGICWALL® LW200 & LW200D

LW200D Structural Capacities

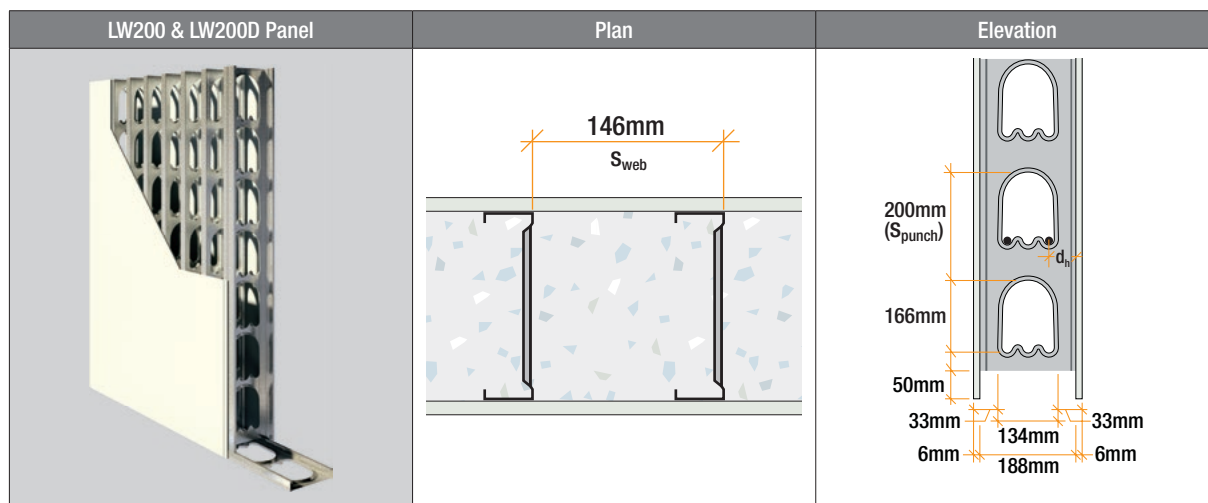


LW200

t_w	S_{web}	S_{punch}	A_c	N_{layers}	d_h	$f'_{c,max}$	Slend. Limit	Max. H_{wu}
188	146	200	50.0%	1	94	50	20	5010

LW200D

t_w	S_{web}	S_{punch}	A_c	N_{layers}	d_h	$f'_{c,max}$	Slend. Limit	Max. H_{wu}
188	146	200	50.0%	2	41	65	30	7520

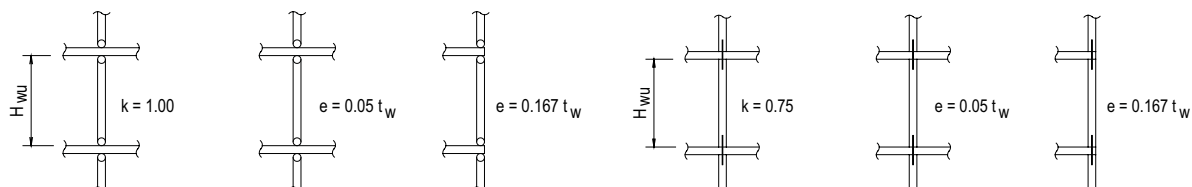

LW200 Axial Capacity ϕN_u (kN/m) Non-Ductile 1 Layers simplified method.

	$k = 0.75$	Discontinuous Floor $e \leq 1/6 t_w$			
H_{wu}	H_{we}	25 MPa	32 MPa	40 MPa	50 MPa
5010	3760	564*	564*	564*	564*
Limit with bottom plate		1742	2230	2787	3859

*AS3600-2018 Sect 11.5.2 Limitations on use of Simplified Design Method

LW200D Axial Capacity ϕN_u (kN/m) Non-Ductile 2 Layers

$k = 0.75$		Continuous Floor $e = 0.05t_w$					Discontinuous Floor $e \leq 1/6t_w$				
H_{wu}	H_{we}	25 MPa	32 MPa	40 MPa	50 MPa	65 MPa	25 MPa	32 MPa	40 MPa	50 MPa	65 MPa
6000	4500	883	1130	1413	1766	2295	626	802	1002	1252	1628
5000	3750	1140	1459	1823	2279	2963	883	1130	1413	1766	2296
4500	3375	1250	1601	2001	2501	3251	994	1272	1590	1988	2584
4200	3150	1311	1679	2098	2623	3409	1055	1350	1688	2109	2742
3900	2925	1368	1751	2189	2736	3557	1111	1423	1778	2223	2890
3600	2700	1421	1818	2273	2841	3693	1164	1490	1862	2328	3026
3300	2475	1469	1880	2350	2938	3819	1212	1552	1940	2425	3152
3000	2250	1513	1937	2421	2026	3934	1256	1608	2010	2513	3267
2700	2025	1553	1988	2485	3106	4038	1296	1659	2074	2593	3370
2400	1800	1589	2033	2542	3177	4130	1332	1705	2131	2664	3463
2100	1575	1620	2074	2592	3240	4212	1363	1745	2182	2727	3545
1800	1350	1647	2109	2636	3295	4283	1391	1780	2225	2782	3616
Bearing capacity at standard bottom plate		1795	2297	2871	3589	4666	1795	2297	2871	3589	4666
Bottom plate may be deleted by the designer											

LW200 Reinforcement

LW200		Vertical Bars (min. N12 - 350)			
Allowable Bars		N12	N16	N20	N24
Horizontal Bars (min. N12 - 350)	N12				
	N16				
	N20				
	N24				
Horizontal Bar Spacing 200/300*/400 Vertical Bar Spacing 150 to 350 $f'_{c,max}$ 65 MPa, Concrete mix as per spec					
Acceptable					
With Caution					
Not Recommended					

LW200D Reinforcement

LW200D		Vertical Bars Each Face (min. N12 - 350)			
Allowable Bars		N12	N16	N20	N24
Horizontal Bars Each Face (min. N12 - 350)	N12				
	N16				
	N20				
	N24				
Horizontal Bar Spacing 200/300*/400 Vertical Bar Spacing 150 to 350 $f'_{c,max}$ 65 MPa, Concrete mix as per spec *Average spacing					
Acceptable					
With Caution					
Not Recommended					


LW200 & LW200D Flexural Capacity (stud only)

Non Fire Rated Flexural Capacity, stud only					
	25 MPa	32 MPa	40 MPa	50 MPa	65 MPa
ϕM_u (kNm/m)	22.8	22.3	22.3	22.4	22.4

Non fire rated capacity, for local wind loads only (ignoring any extra reinforcement)

LW200D Double Reinforcement Lintels

Capacity given is for standard lintel, with minimum reinforcement. Engineer can add extra reinforcement to achieve higher capacity.

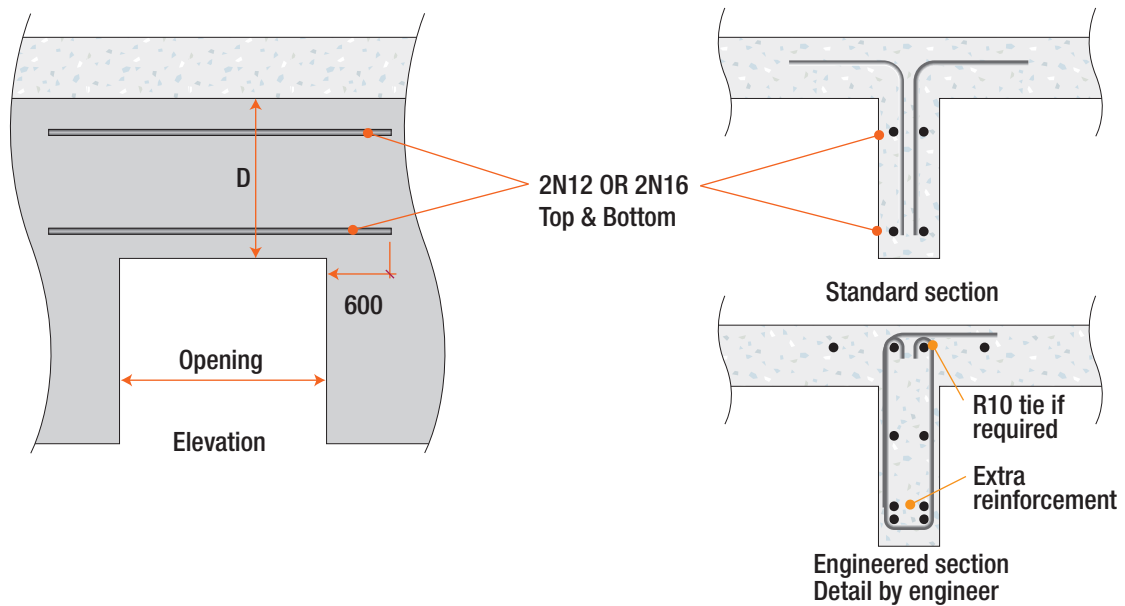


LW200D Standard Lintels with Vertical Studs UDL $w^*(\text{kN/m})$

	2N12 Top & Bottom, Depth (mm)					2N16 Top & Bottom, Depth (mm)				
D	300	450	600	900	1200	300	450	600	900	1200
d _{eff}	200	350	500	800	1100	200	350	500	800	1100
Span (mm)										
3900	11.8	21.4	30.9	50.0	67.5	20.2	37.5	54.9	72.3	72.3
3600	13.9	25.1	36.3	58.7	73.2	23.7	44.1	64.4	78.3	78.3
3300	16.5	29.9	43.2	68.3	79.8	28.2	52.4	76.7	85.5	85.5
3000	20.0	36.1	52.3	75.1	87.8	34.1	63.5	92.8	94.0	94.0
2700	24.7	44.6	64.5	83.4	97.5	42.1	78.3	104.4	104.4	104.4
2400	31.3	56.5	78.0	93.9	109.7	53.3	99.1	117.5	117.5	117.5
2100	40.8	73.7	89.1	107.3	125.4	69.6	128.3	134.3	134.3	134.3
1800	55.6	93.4	104.0	125.2	146.3	94.8	149.7	156.7	156.7	156.7
1500	80.0	112.1	124.8	150.2	175.6	136.5	179.6	188.0	188.0	188.0
1200	124.3	140.1	156.0	187.7	219.5	208.7	224.5	235.0	235.0	235.0
900	165.7	186.9	208.0	250.3	292.6	278.2	299.4	313.3	313.3	313.3
ØM _u (kNm)	16.4	29.6	42.8	69.2	95.6	27.9	51.9	75.9	123.9	171.9
V _{u,max} (kN)	188.0	329.0	470.0	752.0	1034.0	188.0	329.0	470.0	752.0	1034.0
ØV _u (kN)	74.6	84.1	93.6	112.6	131.7	125.2	134.7	141.0	141.0	141.0
	f' _c = 25MPa, 50 cover (min)					f' _c = 25MPa, 50 cover (min)				
	= φV _{uc} governs, otherwise φM _u									


Based on testing (Refer report No C2004-02, titled "Lateral load resistance of AFS wall panels" by University of Centerbury, New Zealand) with $\phi_{\text{bend}} = 0.8$, $\phi_{\text{shear}} = 0.7$ and k_{co} against steel = 0 as per clause 8.4.3 of AS3600-2018

D3.5. LOGICWALL® LW262D

LW262D Structural Capacities

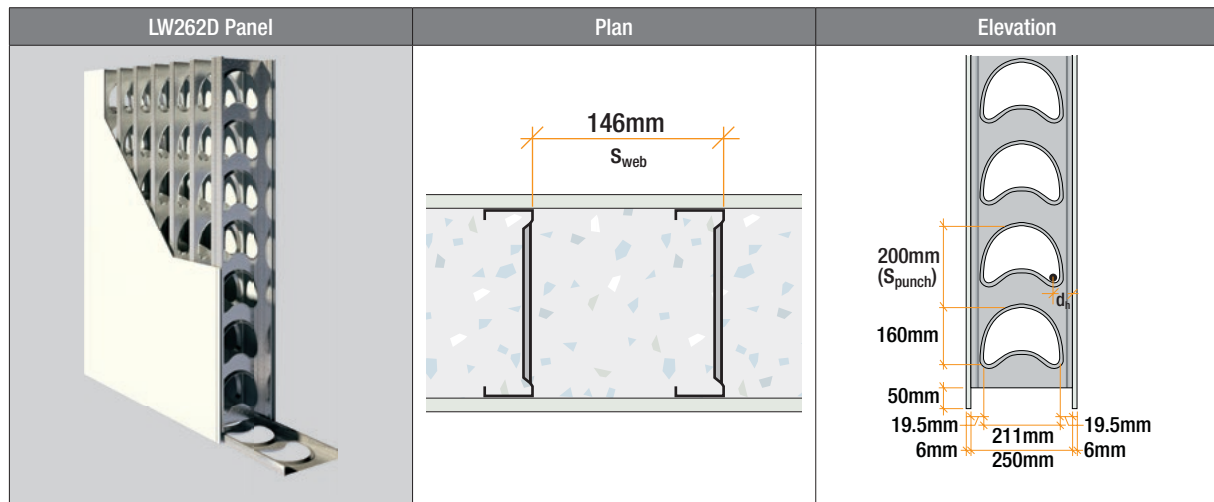

t_w	S_{web}	S_{punch}	A_c	N_{layers}	d_h	$f'_{c,max}$	Slend. Limit	Max. H_{wu}
250	146	200	50.0%	2	45	65	30	10,000

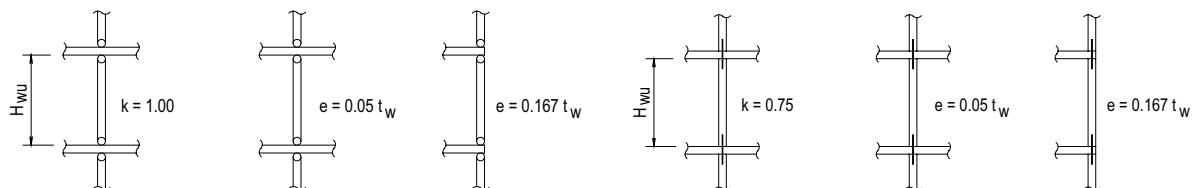

LW262D Axial Capacity ϕN_u (kN/m) Non-Ductile 2 layers

	$k = 0.75$	Continuous Floor $e = 0.05 t_w$					Discontinuous Floor $e \leq 1/6 t_w$				
H_{wu}	H_{we}	25 MPa	32 MPa	40 MPa	50 MPa	65 MPa	25 MPa	32 MPa	40 MPa	50 MPa	65 MPa
6000	4500	1659	2124	2655	3319	4315	1318	1687	2109	2636	3427
5000	3750	1853	2371	2964	3705	4817	1511	1934	2418	3023	3929
4500	3375	1936	2478	3097	3872	5033	1595	2041	2551	3189	4146
4200	3150	1982	2537	3171	3963	5152	1640	2100	2625	3281	4265
3900	2925	2024	2591	3239	4049	5263	1683	2154	2693	3366	4376
3600	2700	2064	2642	3302	4128	5366	1723	2205	2756	3445	4479
3300	2475	2100	2688	3360	4200	5460	1759	2251	2814	3518	4573
3000	2250	2133	2731	3413	4267	5547	1792	2294	2867	3584	4659
2700	2025	2163	2769	3461	4327	5625	1822	2332	2915	3644	4737
2400	1800	2190	2803	3504	4380	5694	1849	2367	2958	3698	4807
2100	1575	2214	2834	3542	4428	5756	1873	2397	2996	3745	4869
1800	1350	2234	2860	3575	4469	5809	1893	2423	3029	3786	4922
Bearing capacity at standard bottom plate		2375	3039	3799	4749	6174	2375	3039	3799	4749	6174

Bottom plate may be deleted by the designer for core walls, shear wall. To be noted on drawings.

LW262D Reinforcement

LW262D		Vertical Bars Each Face (min. N12 - 350)			
Allowable Bars		N12	N16	N20	N24
Horizontal Bars Each Face (min. N12 - 350)	N12				
	N16				
	N20				
	N24				

Horizontal Bar Spacing 200/300*/400

Vertical Bar Spacing 150 to 350

$f'_{c,max}$ 65 MPa, Concrete mix as per spec

*Average spacing

Acceptable
With Caution
Not Recommended


LW262D Flexural Capacity (stud only)

	Non Fire Rated Flexural Capacity, stud only				
	25 MPa	32 MPa	40 MPa	50 MPa	65 MPa
$\phi M_u(kNm/m)$	29.7	29.7	29.8	29.8	29.9

Non fire rated capacity, for local wind loads only (ignoring any extra reinforcement)

LW262D Double Reinforcement Lintels

Capacity given is for standard lintel, with minimum reinforcement. Engineer can add extra reinforcement to achieve higher capacity.

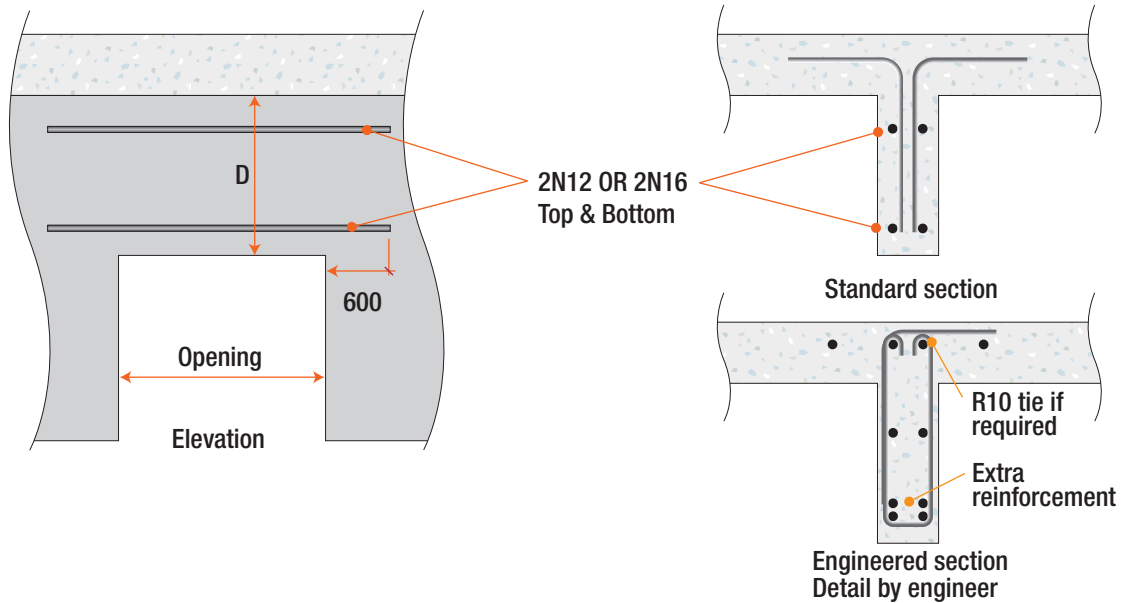

LW262 Standard Lintels with Vertical Studs UDL $w^*(\text{kN/m})$

	2N12 Top & Bottom, Depth (mm)					2N16 Top & Bottom, Depth (mm)				
D	300	450	600	900	1200	300	450	600	900	1200
d _{eff}	242	392	542	842	1142	242	392	542	842	1142
Span (mm)										
3900	12.1	21.6	31.1	50.2	69.3	20.9	38.3	55.6	90.3	96.2
3600	14.1	25.4	36.6	59.0	81.4	24.6	44.9	65.3	99.5	104.2
3300	16.8	30.2	43.5	70.2	93.1	29.2	53.5	77.7	108.5	113.6
3000	20.4	36.5	52.6	84.9	102.4	35.4	64.7	94.0	119.4	125.0
2700	25.2	45.1	65.0	95.2	113.8	43.6	79.9	114.1	132.7	138.9
2400	31.8	57.0	82.3	107.1	128.0	55.2	101.1	128.4	149.3	156.3
2100	41.6	74.5	98.6	122.5	146.3	72.2	132.0	146.7	170.6	178.6
1800	56.6	101.1	115.0	142.9	170.7	98.2	157.2	171.2	199.0	208.3
1500	81.5	121.3	138.0	171.4	204.8	141.4	188.7	205.4	238.8	250.0
1200	127.3	151.6	172.5	214.3	256.1	215.0	235.9	256.7	298.5	312.5
900	174.4	202.2	230.0	285.7	341.4	286.6	314.5	342.3	398.0	416.7
ØM _u (kNm)	16.7	29.9	43.1	69.5	95.9	28.9	52.9	76.9	124.9	172.9
V _{u,max} (kN)	250.0	437.5	625.0	1000.0	1375.0	250.0	437.5	625.0	1000.0	1375.0
ØV _u (kN)	78.5	91.0	103.5	128.6	153.6	129.0	141.5	154.0	179.1	187.5
	f' _c = 25MPa, 50 cover (min)					f' _c = 25MPa, 50 cover (min)				
	= φV _{uc} governs, otherwise φM _u									

Based on testing (Refer report No C2004-02, titled "Lateral load resistance of AFS wall panels" by University of Centerbury, New Zealand) with $\phi_{\text{bend}} = 0.8$, $\phi_{\text{shear}} = 0.7$ and k_{co} against steel = 0 as per clause 8.4.3 of AS3600-2018

D4. Non-Ductile Wall Detailing

Standard AFS wall detailing for Non-Ductile wall designs in accordance with AS3600-2018 Section 2.2 and the relevant clauses in Section 14.4.

Junctions

In general wall junctions are not required to transfer in plane lateral or shear loads across the junctions. Where transfer of in-plane lateral or shear loads across junctions is required the project engineer is to specify

the AFS Special Junction Details on the structural documentation. If detailing is required beyond these special junctions AFS Technical Support is to be consulted and detailing reviewed.

Standard wall junctions

Standard junctions are used except where the structural documentation indicates otherwise. Core walls would generally be specified with special Junctions.

Standard Junctions – Single Reinforcement

Fig D1: Standard Cross Junction

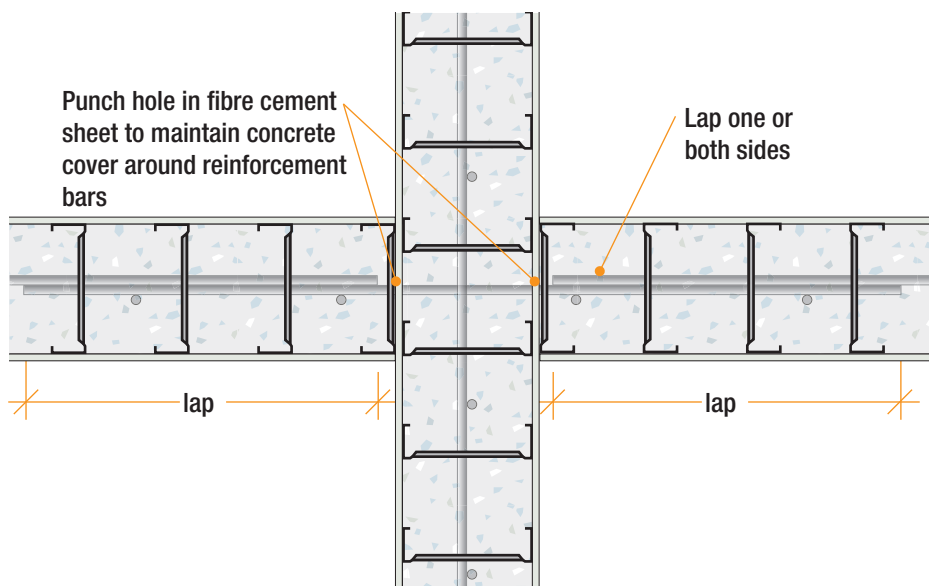


Fig D2: Standard AFS Open Corner Capping

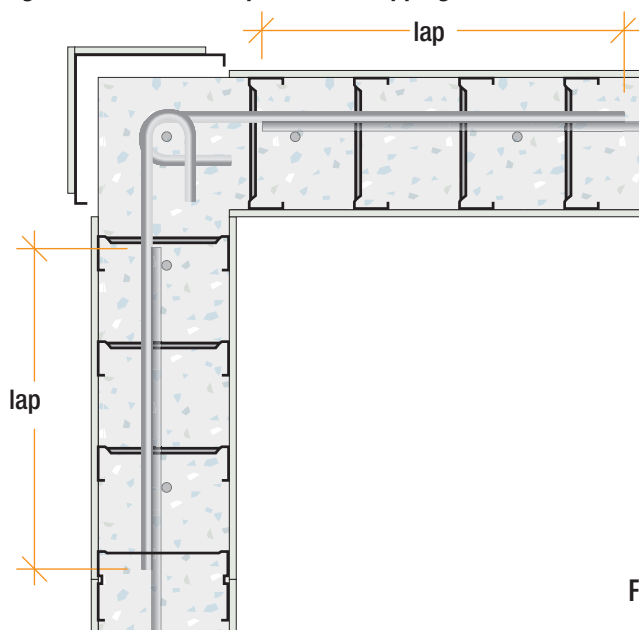


Fig D3: Standard T Junction Capping

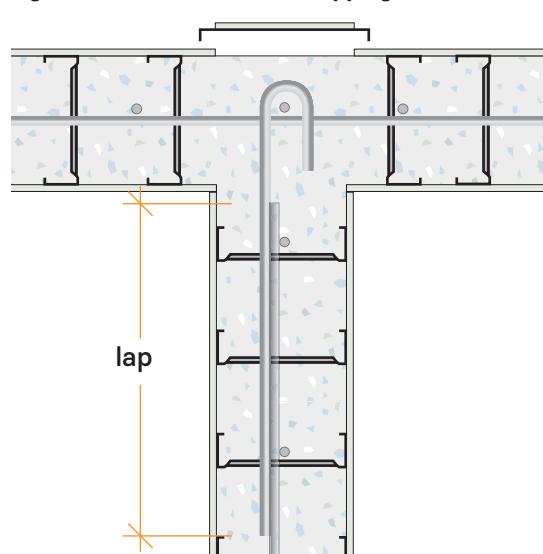


Fig D4: Standard Hook Bars

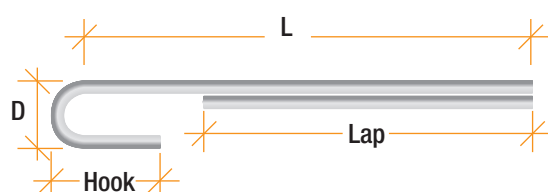


Fig D5: Standard Angle Junction

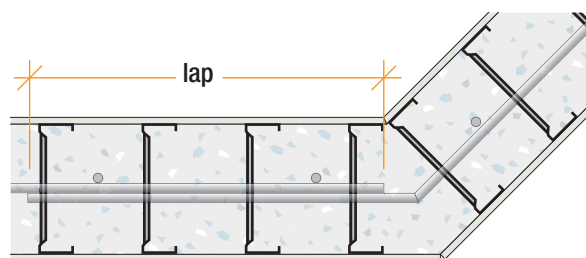


TABLE D6: Standard Hook Bar

Reo	D	L	Hook	Lap*	LW120	LW150	LW162	LW200
N12	60	550	70	450	Y	Y	Y	Y
N16	80	700	70	600	N	Y	Y	Y
N20	100	1000	80	900	N	N	N	Y

*non contact splice $f_c > 32\text{MPa}$, Cover ≥ 30 AS3600 Cl13.1.2, 13.2.2

General notes:

- Standard details used unless specified by structural documentation
- Horizontal wall reinforcement to be stopped clear of junction as shown

Standard Junctions – Double Reinforcement

Fig D6: Standard Cross Junction

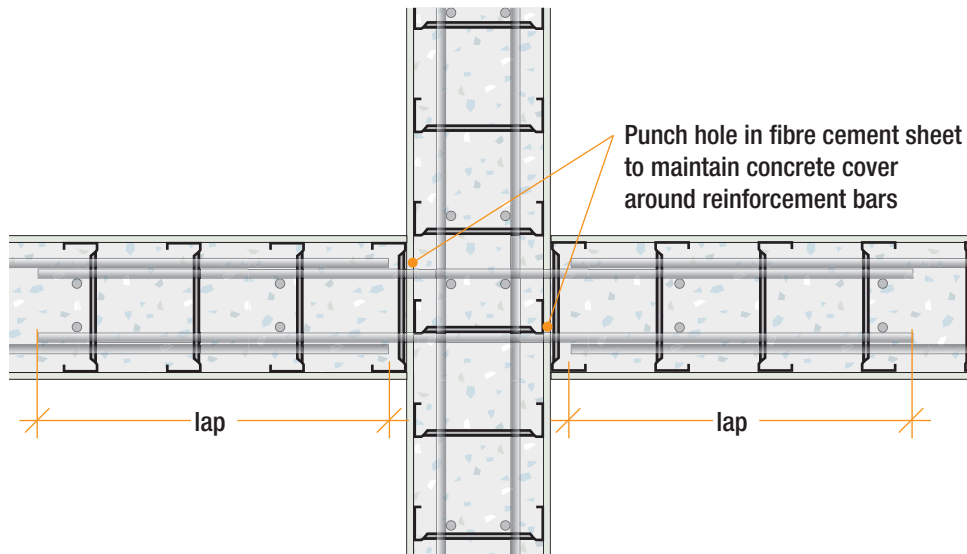


Fig D7: Standard AFS Open Corner Capping

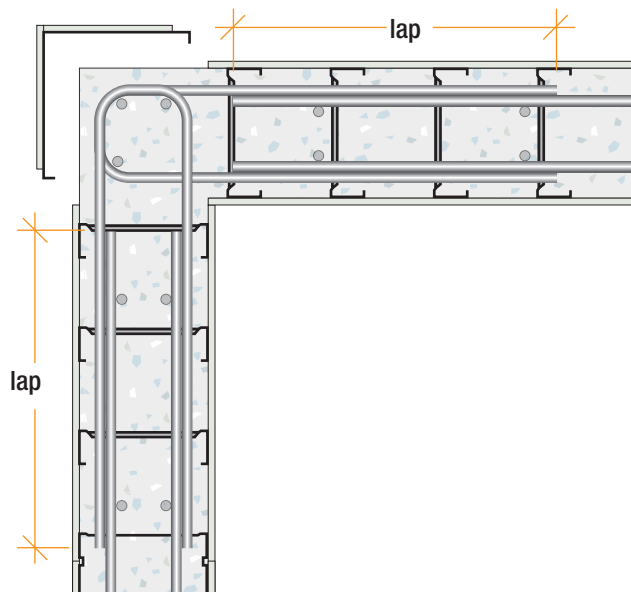


Fig D8: Standard T Wall Junction Capping

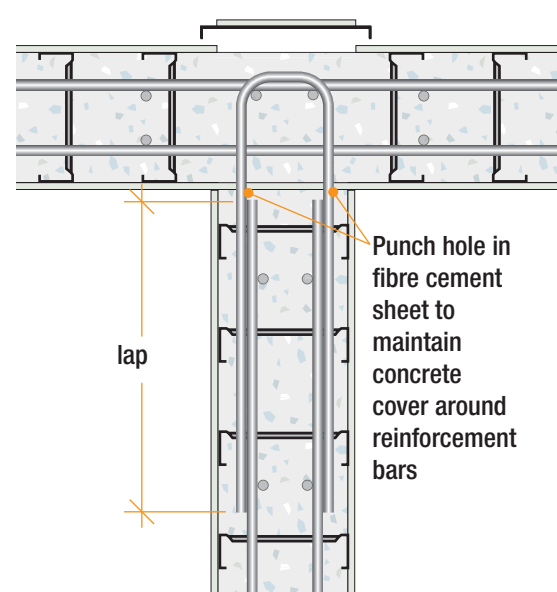


Fig D10: Standard U Bars

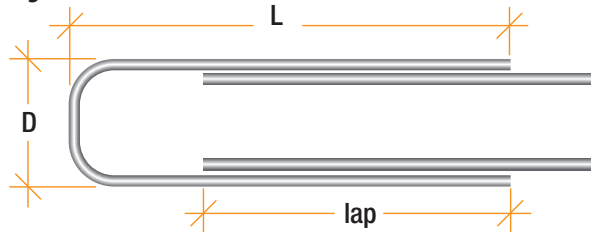


Fig D9: Standard Angle Junction

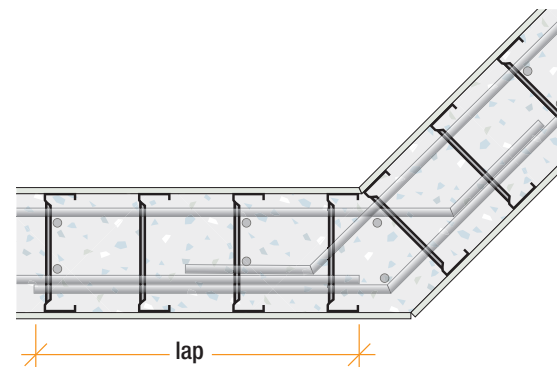


TABLE D7: Standard U Bar

Wall	Reo	D	L	Lap*
LW200D	N12	105	750	450
LW262D	N12	155	750	450
LW262D	N16	155	900	600

*non contact splice $f'_c > 32\text{MPa}$, Cover ≥ 30 AS3600 Cl13.1.2, 13.2.2

Special junctions (where specified by the engineer)

Structural documentation is to specify where Special Junctions are to be used. If detailing is required beyond these special junctions AFS Technical Support is to be consulted and detailing reviewed. Special Junctions are only available for walls with two layers of reinforcement.

Special Junction Details will normally be specified for:

- Core walls
- Deep beams
- Any junction transferring inplane lateral or shear loads.

Special Junctions – Double Reinforcement

Fig D11: Special Cross Junction

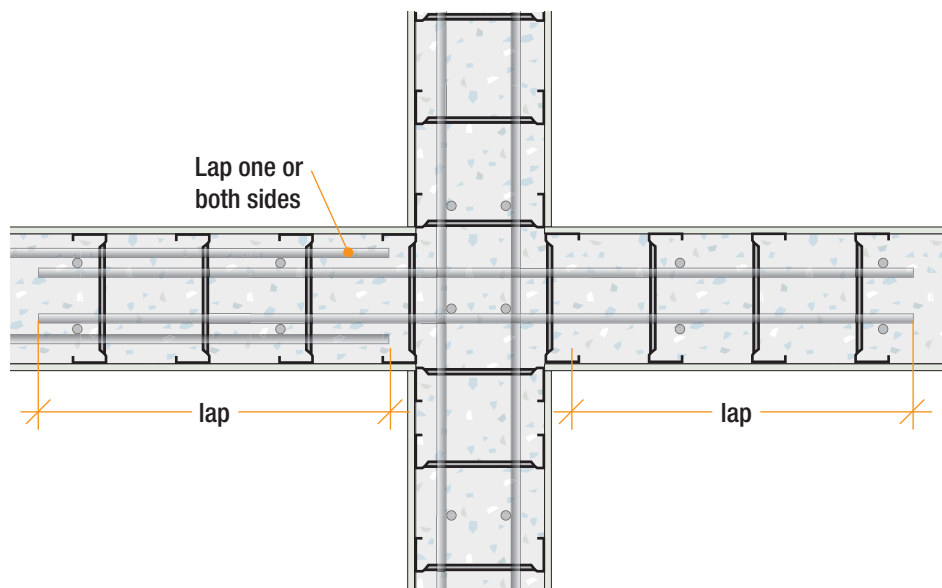


Fig D12: Special AFS Open Corner Capping

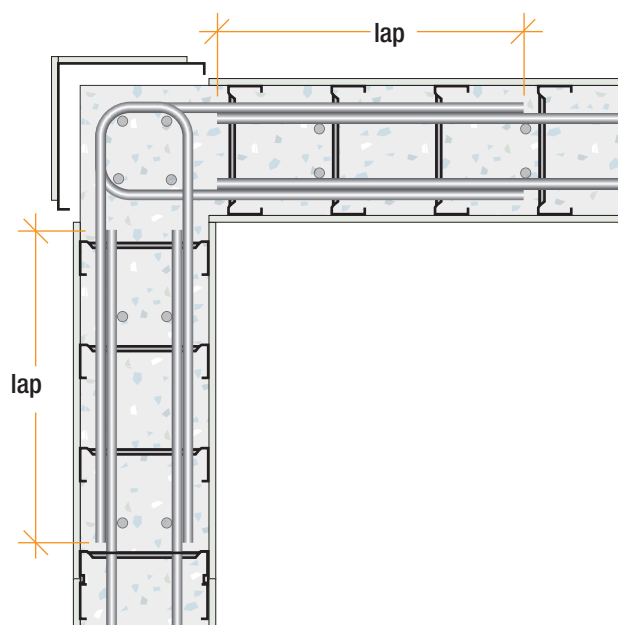


Fig D13: Special T Junction Capping

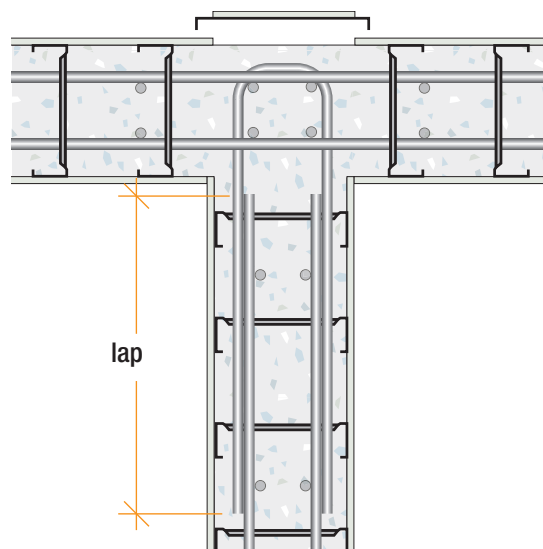


Fig D14: Standard U Bars

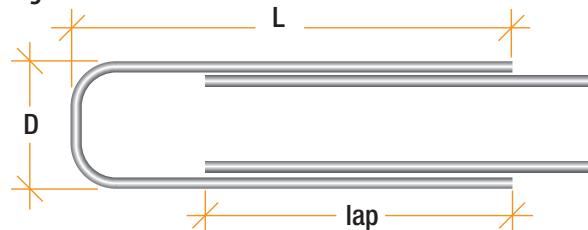


TABLE D8: Standard U Bar

Wall	Reo	D	L	Lap*
LW200D	N12	105	750	500
LW262D	N12	155	750	500
LW262D	N16	155	1050	800

*non contact splice $f_c > 32\text{MPa}$, Cover ≥ 30 AS3600 Cl13.1.2, 13.2.2

General notes:

- Standard details used unless specified by structural documentation
- Horizontal wall reinforcement to be stopped clear of junction as shown

Prefabricated Corners

Limited types of Prefabricated Corners are available on special order. These are limited by weight for fabrication and transport. Installation will require crane assistance.

Prefabricated AFS Logicwall® Corner Details

Fig D15: Standard L-Bar Factory Installed

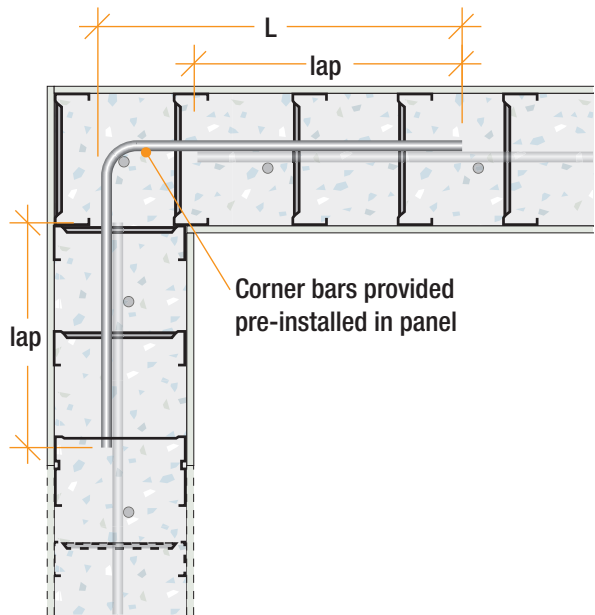


Fig D16: Standard U-Bar Factory Installed

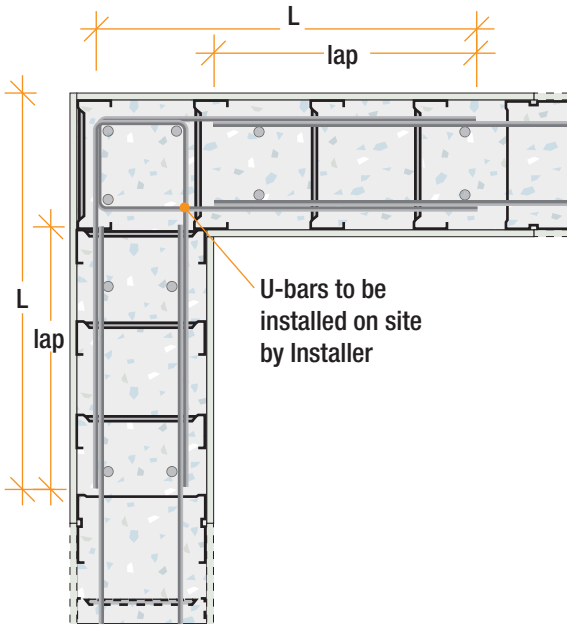


TABLE D9: Prefabricated AFS Logicwall® Corner Bar Details

Wall	Logicwall® Single Layer Corner N12 L Bar	Logicwall® Double Layer N12 U Bar	Lap*
LW120	550	–	450
LW150	550	–	450
LW162	550	–	450
LW200	550	600	450

General notes:

- Details used unless specified by structural documentation
- Horizontal wall reinforcement to be stopped clear of junction as shown
- * non contact splice $f_c > 32\text{MPa}$, Cover ≥ 30 AS3600 CL13.1.2, 13.2.2


Non-Ductile Blade Walls/Columns

AFS uses the following definitions for Blade Walls/Columns.

Blade Walls

Blade walls are short walls designed as non-ductile walls without ligatures in accordance with Section 11 or as limited ductile less than 4 storeys as per Section 14, 11 and 10 of AS3600-2018. They are generally loaded concentrically, with concrete strength not greater than 50MPa and have no net tension in the strong or weak axis.


Fig D17: Logicwall® Blade Wall

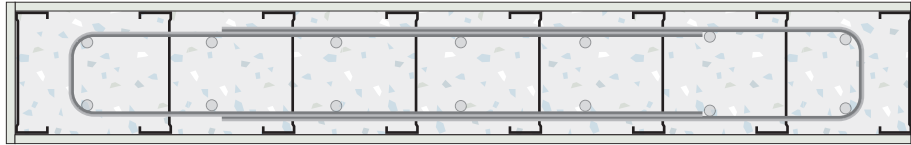

Blade Columns

Are short wall designed as columns with ligatures to AS3600-2018 Sections 14 and 10.

Fig D18: Logicwall® Blade Column

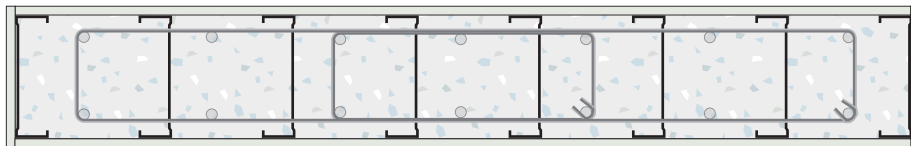

Joints


Various AFS standard joints may be specified on the by the engineer on the structural documentation for non ductile walls as shown in the following sections

Sheet Surface Joint (Internal Surface Only)

Sheet surface joints are 6mm deep, (i.e. the full depth of the fibre cement sheet) to accommodate expansion the fibre cement sheet. These should be placed at max. 6.0m centres at the finishing stage, i.e. after wall is concrete filled at the time of setting the vertical

recessed joints. Locations of sheet surface joints should be nominated by architect, as they can often be concealed behind glazing sections of cupboards. Fig D19 shows details of Logicwall® sheet surface joint.

Fig D19: Logicwall® Sheet Surface Joint

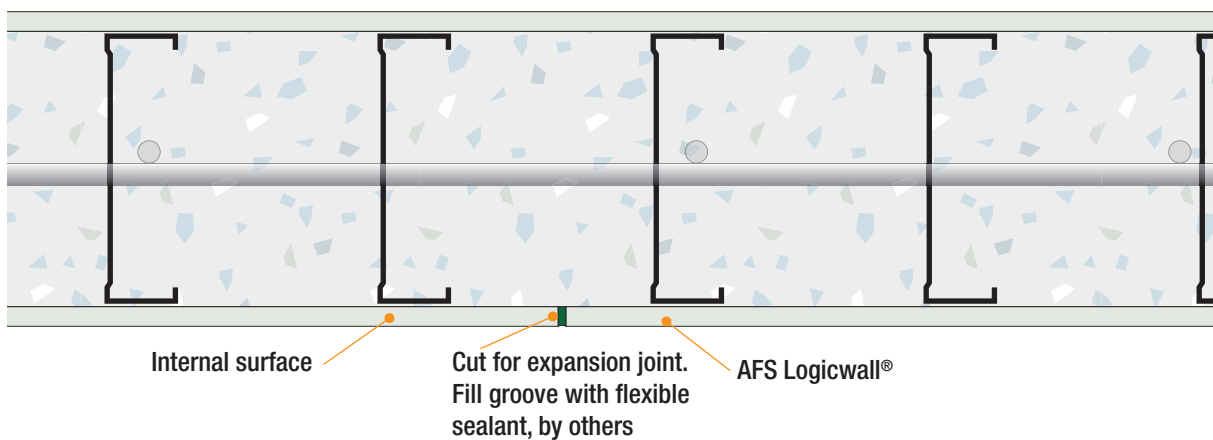


Movement Joints

Movements joints will be required where specified in the project documentation. The structural concrete wall effectively has control joints at each stud so no additional crack control joints are necessary. Full depth "movement joints" may be required depending on the geometry of the structure and other considerations such as thermal loads, exposure and building joints. In general "movement joints" would not be required for

walls less than 16m long. Structural movement joints will be placed in locations nominated by the structural engineer and must be documented on structural drawings. These will be installed at construction stage by the AFS Logicwall® installation contractor. Fig D20 shows details of Logicwall® movement joint.

Fig D20: logicwall® Movement joint

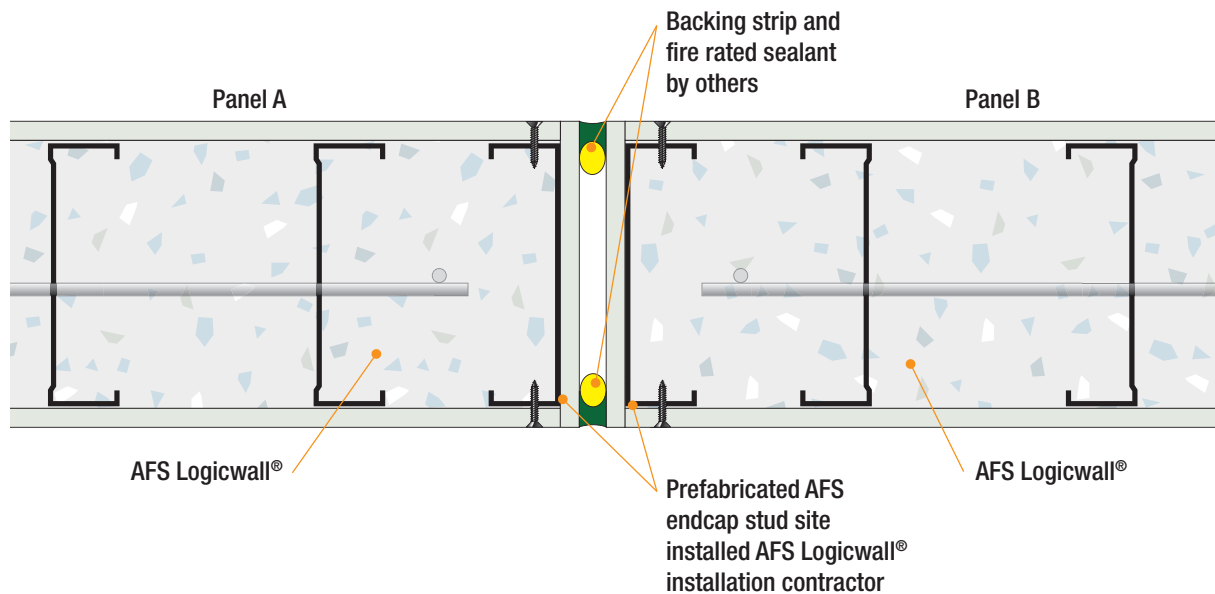

Note: Can be dowel jointed if required structurally. Must be clearly specified and negotiated with installers at time of tender. Installed where nominated by project engineer. Must be clearly documented on drawings. Typically not required in walls less than 16m in length.

Junction joints to structurally isolate walls either side of the junction and prevent transfer of inplane forces.

Fig D21: Logicwall® Corner Joint


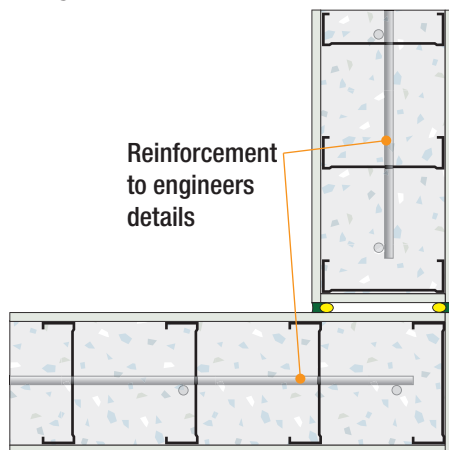



Fig D22: Logicwall® T joint

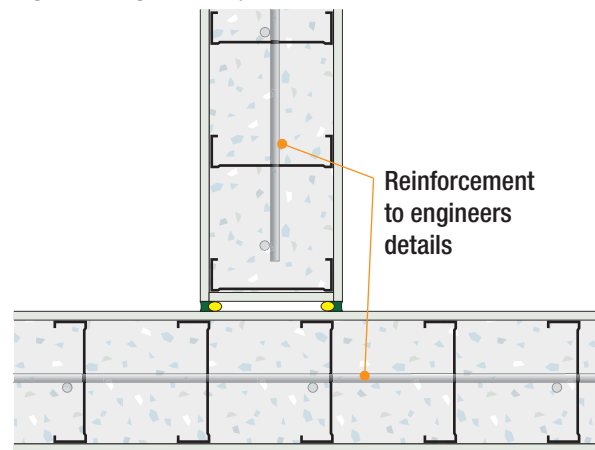

Construction Joint

Construction joints can be used wherever a pour break is required, walls may be split to prevent transfer of in-plane forces. Locations are to be specified on the project documentation.

Fig D23: Logicwall® Construction Joint

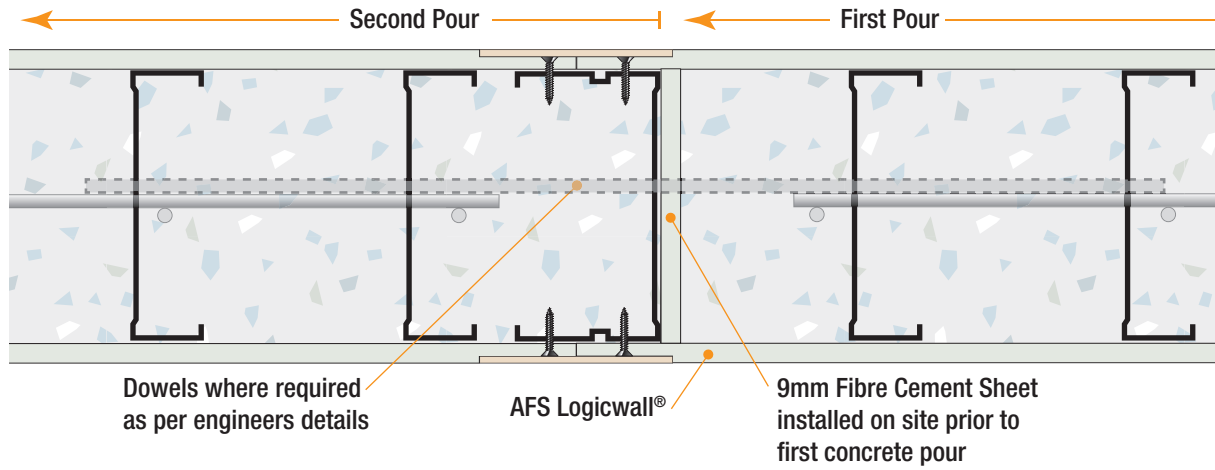

D5. Limited Ductile Wall Design

Limited Ductile Design


AFS Logicwall® can be designed to the requirements of AS3600-2018 Limited Ductile Walls. Limited Ductile Walls are to be designed to Section 2.2, Clause 14.4 and Clause 14.6 of AS3600-2018. Clause 14.6.1 requires the Limited Ductile walls to have reinforcement on each face and be detailed in accordance with the requirements of Clause 14.6.

Refer to the following sections for standard detailing to suit Logicwall® Limited Ductile Walls with boundary elements.

AFS Limited Ductile Walls are only to be installed by AFS approved experienced installers due to the additional detailing requirements. AFS detailing is to be used unless AFS Technical Support reviews and approves alternate detailing.

Below is a sample Moment Interaction curve showing LW200 capacity without core confinement.

Fig D24: Sample Moment Interaction

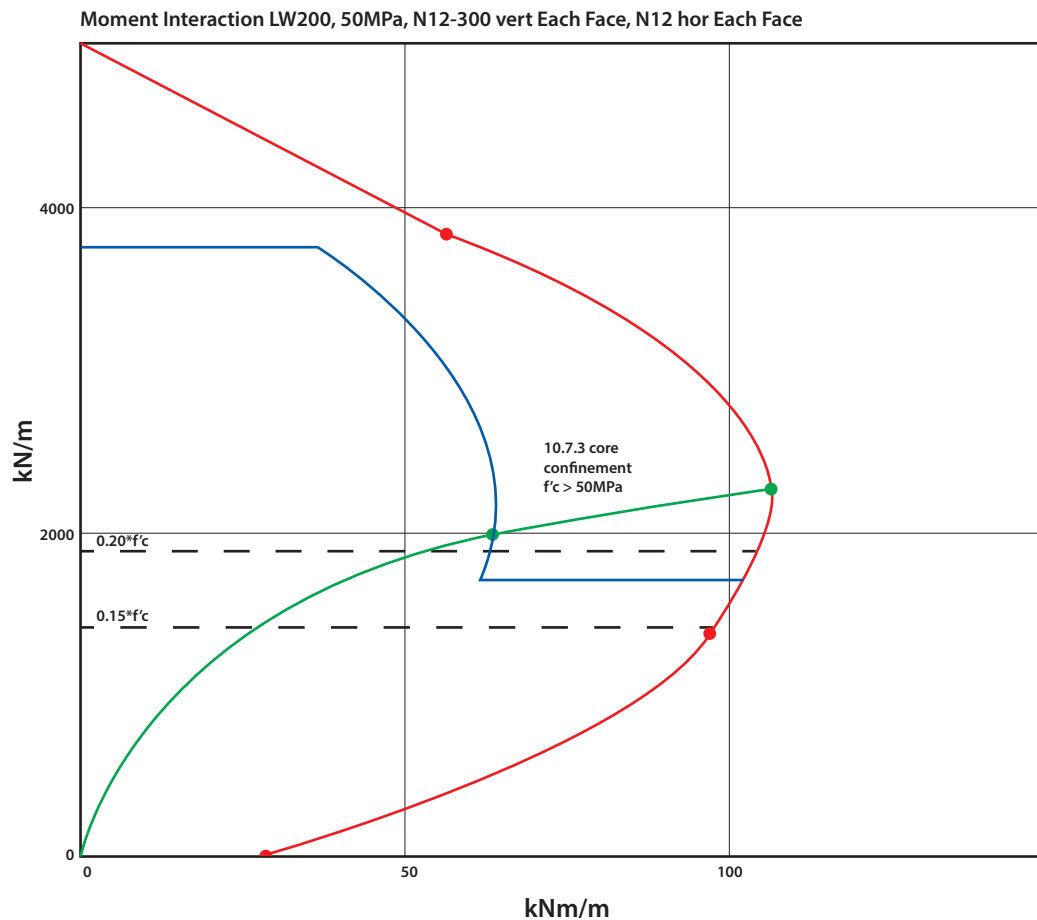

Limited Ductile Design Examples

The table below provides other design examples for Logicwall® over a range of reinforcement and concrete strengths.


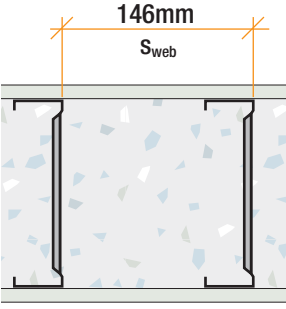
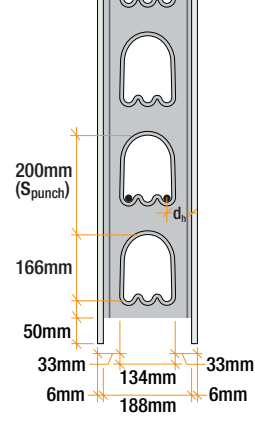

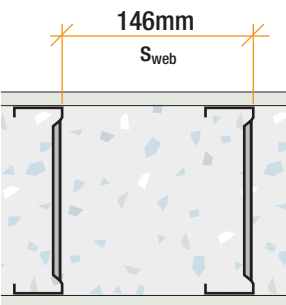
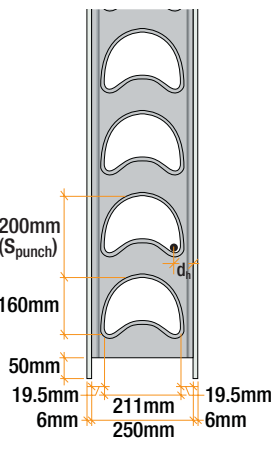
	Panel	Plan	Elevation
LW200			
LW262D			

TABLE D10: Logicwall® Panel Properties

Wall Type	t_w	t_{fire}	N_{layers}	Slend. Limit	d_h	$f'_{c,max}$	A_c	Minimum Reinforcement
LW200D	188	146	2	30	41	50	50.0%	N12-200 Hor. N12-300 Vert.
LW262D	250	260	2	30	45	50	49.5%	N12-200 Hor. N12-375 Vert.

TABLE D11: Logicwall® Design Axial Force

Wall Description	Cl 11.7.4	H_{wu} $K=0.75$ (mm)	t_w (mm)	d_c (mm)	p	$\emptyset N_u$ $\emptyset N(Cl\ 10.7.3)$ (kN/m)	14.6.2.1 $0.15 \cdot f'_c$ (kN/m)
LW200, 32MPa, N12-300 vertical Each Face, N12 Horizontal	Each Face ($<1\%$)	3000	188	53	0.0040	1560 (-)	902
LW200, 50MPa, N12-300 vertical Each Face, N12 Horizontal	Each Face ($<1\%$)	3000	188	53	0.0040	2250 (-)	1410
LW200, 50MPa, N16-220 vertical Each Face, N12 Horizontal	Each Face ($<1\%$)	3000	188	53	0.0097	2370 (-)	1410
LW262, 32MPa, N12-300 vertical Each Face, N12 Horizontal	Each Face ($<1\%$)	3000	250	57	0.0030	3040 (-)	1200
LW262, 50MPa, N12-300 vertical Each Face, N12 Horizontal	Each Face ($<1\%$)	3000	250	57	0.0030	4470 (-)	1875
LW262, 50MPa, N20-250 vertical Each Face, N12 Horizontal	Each Face ($<1\%$)	3000	250	61	0.0100	4820 (-)	1875

D5.1. Limited Ductile Wall Detailing

Standard AFS Wall Detailing for Limited Ductile Wall Designs in accordance with AS3600-2018 Section 2.2 and Clauses in 14.4 and 14.6. All limited Ductile Walls will have 2 Layers of reinforcement.

designed in accordance to AS3600-2018 Clause 14.6 with $f'_c \leq 50$ MPa. If fitments are required in small areas outside of boundary elements consult the AFS Technical Support for assistance.

In general Wall fitments are not used in AFS Walls when

Boundary Elements

AS3600-2018 Cl14.6.2 Boundary Elements requires Boundary Elements where extreme fibre compressive stress exceeds $0.15 f'_c$. The extent and detailing of the boundary elements are to be determined by the designer.

requirements and are only to be installed by AFS approved experienced installers. AFS detailing is to be used unless AFS Technical Support reviews and approves alternate detailing.

AFS Boundary Elements have special installation

Reinforcement

In accordance with AS3600-2018 Cl14.6.7 maximum vertical reinforcement for AFS Logicwall® shall be 2.1% (AS3600-2018 cl 14.6.7 $21/f_{sy}$ at laps) including


areas with boundary elements and laps. Minimum horizontal and vertical reinforcement shall be 0.0025.

Structures not more than four storeys

“For structures not more than four storeys above their structural base and where boundary elements are required” [AS3600 Cl14.6.2.2] the AFS standard end detail may be used as the boundary element.


AFS Standard Boundary Element will be used at all Boundaries unless specified in the project documentation.

Fig D25: AFS Standard Boundary Element Not more than Four Storeys

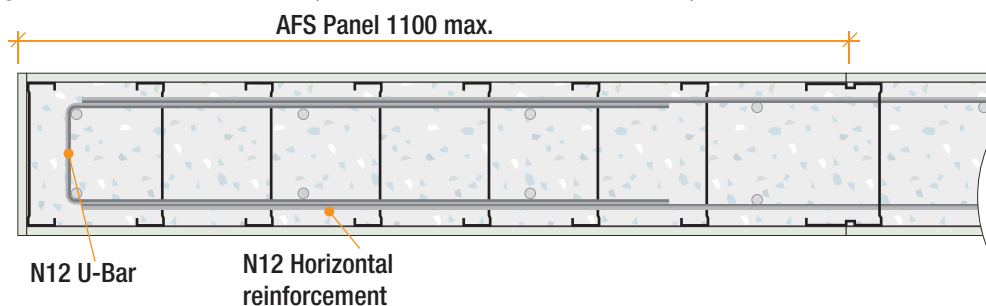

Structures more than four storeys


For structures more than four storeys CI14.6.2.3 requires boundary elements to conform to CI10.7.4. The AFS Standard Boundary Element below can be installed during installation of the walls.

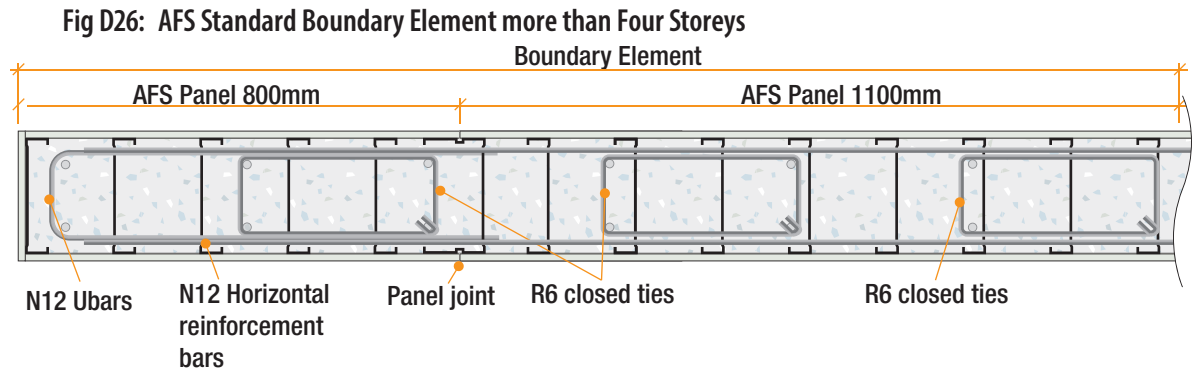

Boundary elements closed fitments are to be spaced vertically in accordance with CI 14.6.2 of AS3600-2018 as follows:

- Spaced at lesser of t_w and 200mm
- For structures more than four storeys as per CI 14.6.2.3 of AS3600-2018.

Fig D27: AFS Limited Ductile Core Wall Detailing

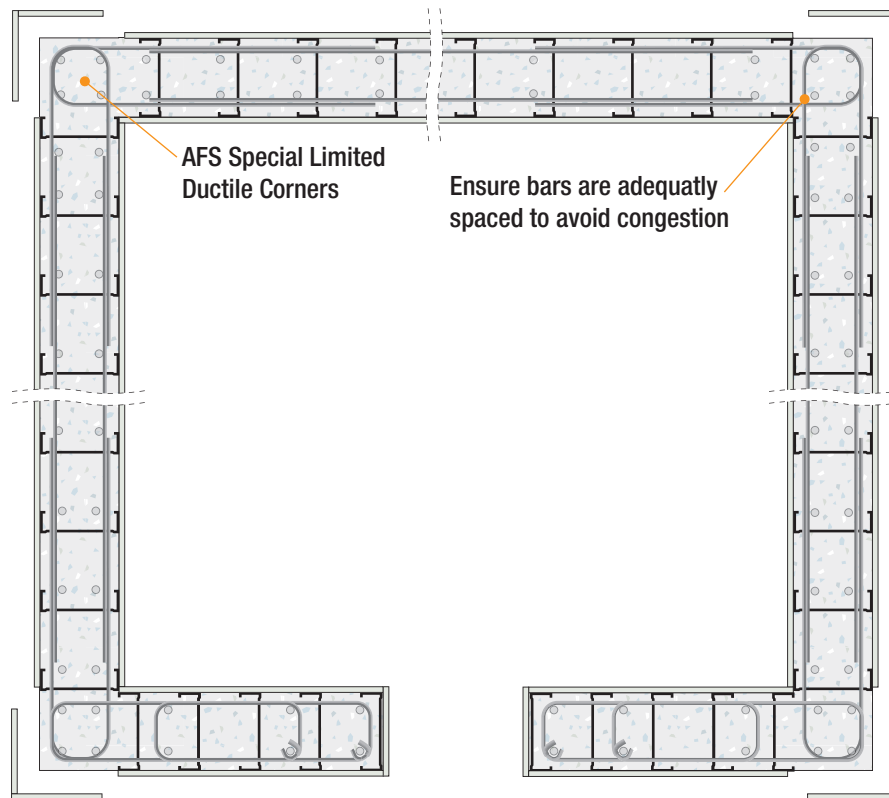


AFS Limited Ductile Wall Horizontal Reinforcement Wall Laps

AFS recommends Fig 14.6.7(D) of AS360-2018 only be used where required. Alternatives to the 14.6.7 detail are:

- Construction joints to split the walls and prevent transfer of in-plane lateral and shear loads.

Fig D28: Horizontal Wall Bar Lap Detail - 14.6.7(D)

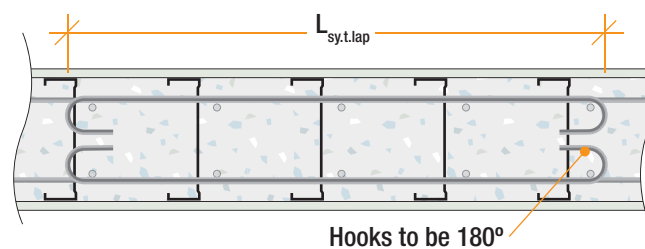


Blade Columns

Blade Columns

Are short wall designed as columns with ligatures to AS3600-2018 Sections 14 and 10.

Fig D29: Logicwall® Blade Column

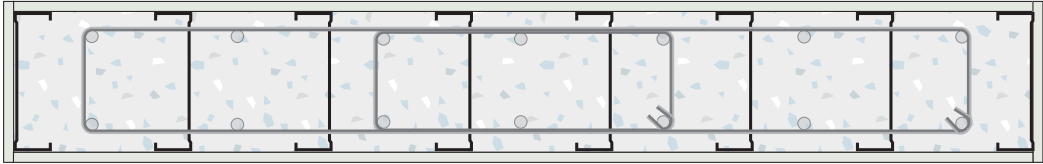

Junctions

AFS Standard Junctions

Standard Junctions are not to be used with Limited Ductile Walls. Junction joints may be used to structurally isolate walls either side of the junction and prevent transfer of in-plane forces

AFS Special Junctions

Structural documentation is to specify where Special Junctions are to be used. If detailing is required beyond these special junctions AFS Technical Support is to be consulted and detailing reviewed.

Special limited Ductile Junction Details –Without Boundary Elements

Fig D30: Special Corner Type 1

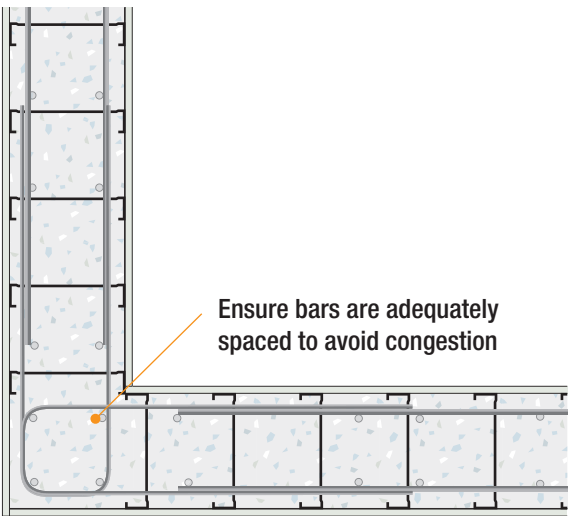


Fig D31: Special T junction

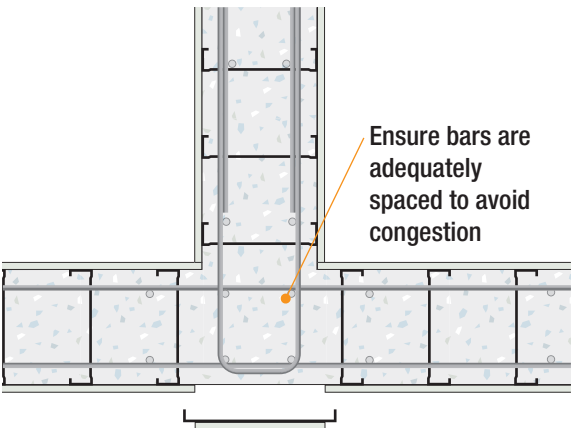


Fig D32: Special Angle Junction

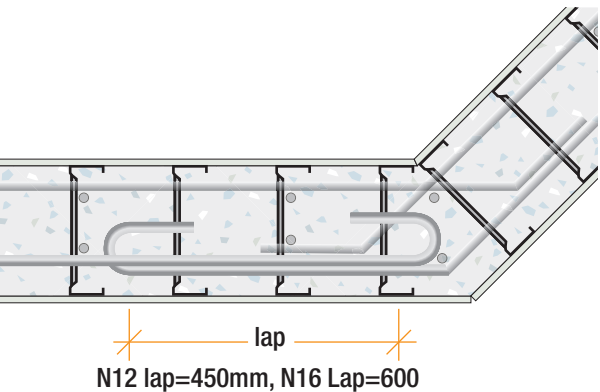


Fig D33: Standard U Bars

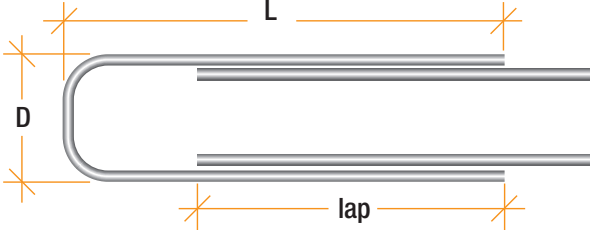


TABLE D12: Special U Bar

Wall	Reo	D	L	Lap*
LW200D	N12	105	750	500
LW262D	N12	155	750	500
LW262D	N16	155	1050	800

*non contact splice $f'_c > 32\text{MPa}$, Cover ≥ 30 AS3600 Cl13.1.2, 13.2.2

Movement Joints


Movement joints will be required over any building joints and where specified on the project documentation

The structural concrete wall effectively has control joints at each stud so no additional crack control joints are necessary. Full depth "movement joints" may be required depending on the geometry of the structure and other considerations such as thermal loads, exposure and building joints. In general "movement

joints" would not be required for walls less than 16m long. Structural movement joints will be placed in locations nominated by the structural engineer and must be documented on structural drawings. These will be installed at construction stage by the AFS Logicwall® installation contractor.

The following method is recommended.

Fig D34: Logicwall® Movement joint

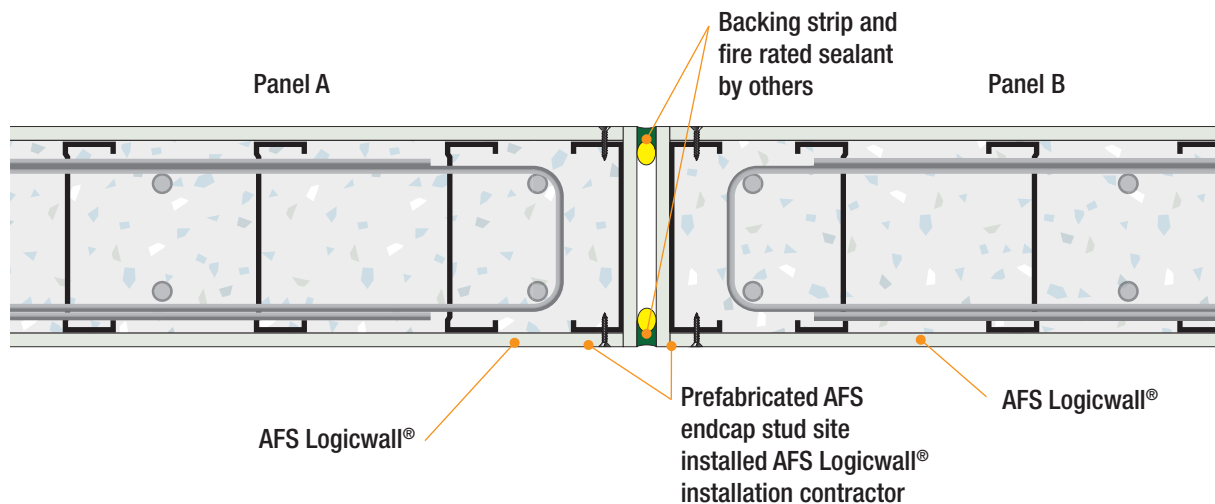


Note: Can be dowel jointed if required structurally. Must be clearly specified and negotiated with installers at time of tender. Installed where nominated by project engineer. Must be clearly documented on drawings. Typically not required in walls less than 16m in length.

Construction Joint

Construction Joints can be used wherever a pour break is required, walls may be split to prevent transfer

of in-plane forces. Locations are to be specified on the Project Documentation.

Fig D35: Logicwall® Sheet Surface Joint

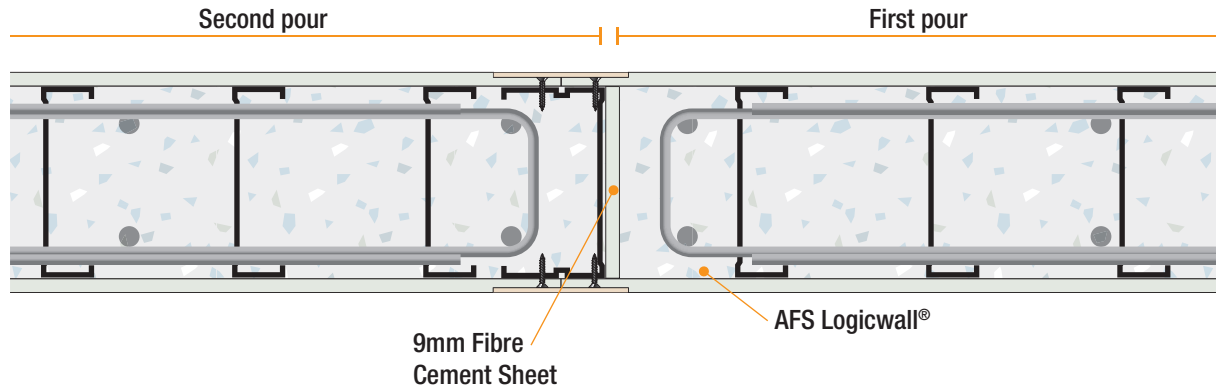

Wall Junctions Joints

Junction Joints to structurally isolate walls either side of the junction and prevent transfer of inplane forces.

Fig D36: Logicwall® Corner Joint


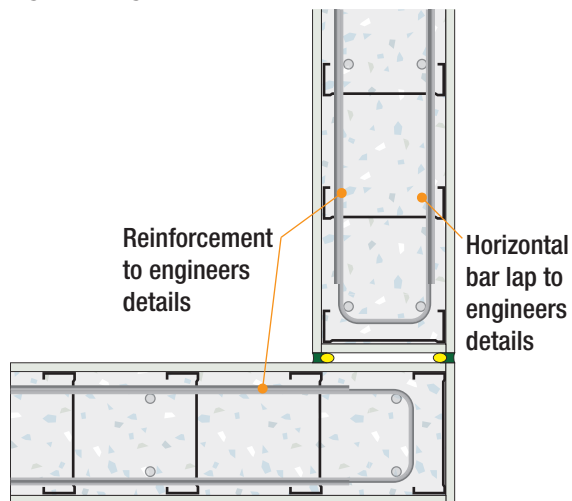


Fig D37: Logicwall® T joint

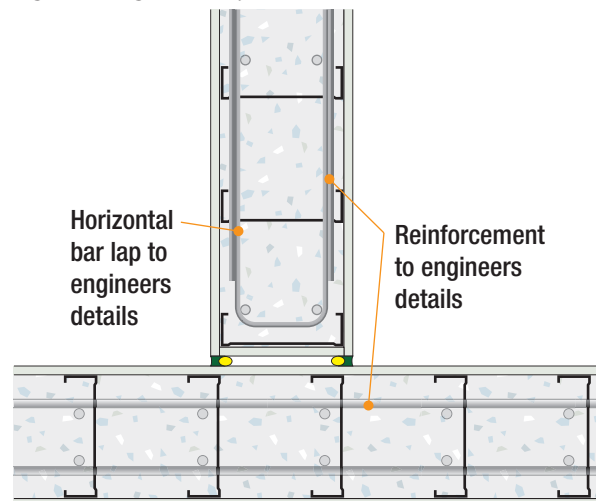

D6. CORE FILLING OF WALLS

Introduction

AFS Logicwall® is to be filled with AFS special concrete mix. The concrete mix and concrete placement technique is critical to the successful outcome of filling logicwall®.

AFS has carried out tests which achieved desired compaction and dense, homogeneous coverage of AFS Logicwall®.

This guide sets out the methods used by AFS to achieve suitable compaction.

Use of this guide or an equivalent procedure to achieve compaction of Logicwall® is entirely at the discretion of the contractor or installer.

The contractor or installer is responsible for achieving compaction and dense, homogeneous coverage of the concrete mix in Logicwall®. AFS accepts no responsibility for achieving compaction of the concrete in AFS Logicwall® or core filling of walls.

Refer to "Core Filling of Walls" on page K34 for further information.

Concrete Pour Limitations

When panel installation is complete and all appropriate bracing and checks completed, the walls can be filled with concrete.

The quantity of concrete that can be poured in a day must be assessed and determined in consideration of the following factors:

- Ease of access
- Number of passes (or lifts) that are required
- Concrete gelling time between passes
- Consideration of wet weather

For wet weather, on-site conditions should be assessed and the concrete pour either be delayed or be undertaken with caution, applying measures to suit the given conditions.

Additional Equipment Required for Concrete Pour

Prior to commencing a pour, ensure that a concrete vibrator with flexible shaft and 38mm head is ready for use, and that multiple shovels, trowels, screw guns, screws and at least one wheelbarrow are readily available.